
Instruction Manual MN013002EN


Series NRX with PXR - type RF low voltage power (air) circuit breakers instruction manual

Instructions apply to:



UL489 series NRX RF frame IEC IZMX40

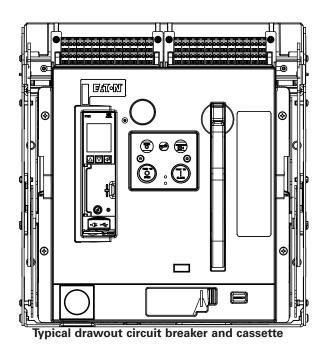



Typical fixed circuit breaker



Please see page 18 for important accessory rating changes.

Table of Contents

SECT	TION 1: INTRODUCTION	
	Safety	
	Qualified personnel	
	General information.	
	Product labeling and identification.	
	Breaker overview	
	Drawout breaker and cassette	
	Fixed circuit breaker	
CECT		
SECT	TION 2: RECEIVING, UNPACKING, AND INSPECTION	
	Circuit breaker unpacking and inspection	
	Circuit breaker inspection	
	Storing circuit breaker	. 10
SECT	ION 3: GENERAL OPERATION AND CIRCUIT BREAKER DESCRIPTION .	
	Introduction	
	Installing the drawout circuit breaker in the cassette	
	Rejection interlocks	
	Drawout circuit breaker positioning	
	Installing fixed circuit breaker	.14
	Basic circuit breaker assembly	
	Operating mechanism	
	Manual operation	
	Electrical operation	
	Anti-pump Feature	. 16
SECTI	ON 4: CIRCUIT BREAKER FEATURES AND ACCESSORIES	16
	Introduction	.16
	Arc chambers	. 16
	Electronic tripping system	.16
	Microprocessor-based trip unit	.16
	Rating plug	. 17
	Current sensors	. 17
	Frame rating module	. 17
	Trip actuator	. 17
	Fixed high instantaneous non-adjustable trip	. 17
	Non-automatic device	. 17
	Secondary contacts and connection diagrams	.18
	General wiring notes	.18
	Accessory devices	. 19
	Accessory tray devices	. 19
	Left accessory tray	. 19

	Right accessory tray	19
	Shunt trip (ST)	20
	Undervoltage release (UVR)	20
	Overcurrent trip switch (OTS)	20
	Auxiliary switch	20
	Other internal electrical devices	20
	Spring release (SR)	20
	Latch check switch (LCS)	20
	Motor Operator	20
	Mechanical devices	20
	Non-interlocked pop-out mechanical trip indicator	20
	Interlocked pop-out mechanical trip indicator	21
	Operations counter	21
	Off key lock	21
	Pushbutton cover	21
	Safe-off pushbutton cover	21
	Cassette safety shutters	21
	Door escutcheon	
	IP55 dust and water resistant cover	
	Mechanical interlock	21
	Publications	21
	CTION 5: DIMENSIONAL DRAWINGS FOR	
NS	TALLATION OF DRAWOUT CIRCUIT BREAKERS	
	General	
	Drawout cassette	23
SEC	CTION 6: DIMENSIONAL DRAWINGS FOR	
SEC NS	TALLATION OF FIXED CIRCUIT BREAKERS	
SEC NS	TALLATION OF FIXED CIRCUIT BREAKERS	42
SEC NS	TALLATION OF FIXED CIRCUIT BREAKERS	42
NS	TALLATION OF FIXED CIRCUIT BREAKERS	42
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker	42 42 59
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker TION 7: INSPECTION AND MAINTENANCE	42 42 59
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General	42 42 59 59
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations	42 59 59 59
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect What to inspect	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect What to inspect Functional field testing	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test.	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test. Electrical operation functional test	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test Electrical operation functional test Trip unit test procedure	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test. Electrical operation functional test Trip unit test procedure Arc chute inspection	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test. Electrical operation functional test Trip unit test procedure Arc chute inspection Primary contact inspection	
NS	TALLATION OF FIXED CIRCUIT BREAKERS General Fixed circuit breaker CTION 7: INSPECTION AND MAINTENANCE General General General recommendations When to inspect What to inspect Functional field testing Manual operation functional test Electrical operation functional test Trip unit test procedure Arc chute inspection Primary contact inspection Miscellaneous modifications and/or changes	

Instruction Manual MN013002EN

SECTION 8: TROUBLESHOOTING	62
Introduction	.62
DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITY	64

A

WARNING

The warnings and cautions included as part of the procedural steps in this manual are for personnel safety and protection of equipment from damage. This example of a typical warning is intended to familiarize personnel with the style of presentation.



WARNING

Series NRX circuit breakers are provided with safety features. Nevertheless, the voltages, currents, and power levels available around operational equipment are extremely dangerous. Under no circumstances should interlocks and other safety features be made inoperative, as this may result in death, bodily injury, or property damage.



WARNING

Series NRX circuit breakers should not under any circumstances be applied outside their nameplate ratings. Operation outside of these ratings could result in death, bodily injury, or property damage.



WARNING

Never attempt to disable any interlocks. Doing so could result in an electrical fault that could result in death, bodily injury, and/or equipment damage.



WARNING

Failure to inspect, clean, and maintain circuit breakers can reduce equipment life or cause the equipment to not operate properly under faulty conditions. This could result in equipment damage, bodily injury, or even death.



WARNING

Arc chutes and their cover plates must always be secured properly in place before a breaker is installed in its compartment. Failure to do so could result in equipment damage, bodily injury, or even death.



WARNING

The circuit breaker mechanism contains stored mechanical energy and moving parts and should be operated with the front cover and arc chutes in place. Parts may move forcefully and without warning. If the front cover or arc chutes have been removed, limit contact to the handle and buttons. Failure to do so may result in serious bodily injury.



CAUTION

Do not attempt to lift a breaker or cassette with ordinary crane hooks or chains. Damage to vital circuit breaker parts could result. Use two appropriate lifting straps when using any type of lifting device.



CAUTION

Make certain that the cassette is properly mounted or seated securely on a work table before attempting to have the breaker fully extended on the cassette's drawout rails. Failure to comply could result in the cassette tipping forward resulting in equipment damage and/or bodily injury.



CAUTION

Do not store equipment on its back. This could result in equipment damage.



CAUTION

It is important to take care when placing a drawout circuit breaker on its extension rails. If the circuit breaker is not properly seated on the rails, the breaker could fall causing equipment damage and/or bodily injury.



CAUTION

Inspection and maintenance procedures should be carried out only by personnel familiar with the hazards associated with working on power circuit breakers. Additionally, they should become familiar with the specifics associated with Series NRX circuit breakers as presented in this manual.



IMPORTANT

Please read and understand these instructions before attempting to unpack, install, operate, or maintain this equipment. Study the breaker and its mechanism carefully before attempting to operate it on an energized circuit.



IMPORTANT

A circuit breaker stored for any length of time should be operated a minimum of five times before it is placed in service.



IMPORTANT

The circuit breaker mechanism is interlocked such that charged closing springs are automatically discharged if the circuit breaker is levered into or out of the cell. Discharge takes place between the DISCONNECT and TEST positions.



IMPORTANT

Different degrees of access to push-buttons on the front of the circuit breaker can be achieved through the use of optional accessory devices.



IMPORTANT

Before doing any work, make sure a drawout breaker is levered out to the TEST, DISCONNECT, or WITHDRAWN position. During the levering out and levering in of the circuit breaker, be aware of any signs that would indicate that the levering process is not working properly. If working on a fixed circuit breaker, bus systems should be de-energized for convenience and safety. All circuit breakers should be switched to the OFF position and the mechanism springs discharged.

Instruction Manual MN013002EN

Section 1: Introduction

Purpose

This instructional manual is intended to generally cover the installation, operation, and maintenance of Series NRX™ low voltage power (air) circuit breakers and drawout cassettes. Basic dimensional information is provided for the installation of both the circuit breaker and cassette.

Refer to other documentation for more specific details.

- MN013003EN: Operating Manual for Series NRX PXR 20/25
- 2. AD013001EN: PXR 20/25 Time Current Curves
- 3. TD013001EN: Wiring Diagrams for PXR 20/25
- Accessory field installation instruction leaflets (IL) dedicated to specific items are available for download at www.eaton.com/seriesnrx.
- Visit www.eaton.com/seriesnrx for additional support documentation.

Safety

All safety codes, safety standards, and/or regulations must be strictly observed in the installation, operation, and maintenance of this equipment.



WARNING

The warnings and cautions included as part of the procedural steps in this manual are for personnel safety and protection of equipment from damage. This example of a typical Warning is intended to familiarize personnel with the style of presentation.



IMPORTANT

Please read and understand these instructions before attempting to unpack, install, operate, or maintain this equipment. Study the breaker and its mechanism carefully before attempting to operate it on an energized circuit.

All possible contingencies that may arise during installation, operation, or maintenance, and all details and variations of this equipment do not purport to be covered by these instructions. If further information is desired by purchaser regarding a particular installation, operation, or maintenance of particular equipment, contact the local Eaton representative.



WARNING

Series NRX circuit breakers are provided with safety features. Nevertheless, the voltages, currents, and power levels available around operational equipment are extremely dangerous. Under no circumstances should interlocks and other safety features be made inoperative, as this may result in death, bodily injury, or property damage.

Safe practices

To protect personnel associated with the installation, operation, and maintenance of this equipment, the following practices must be followed.

- Only qualified electrical personnel familiar with the equipment, its operation, and the associated hazards should be permitted to work on, install, or operate the equipment.
- Always be certain that the primary and secondary circuits are de-energized or the circuit breaker is open and removed to a safe work location before attempting any maintenance.
- 3. For maximum safety, only insert an open, completely assembled breaker into an energized cell.
- 4. Always ensure that drawout circuit breakers are in one of their designed cell positions, such as CONNECT, TEST, DISCONNECT, or WITHDRAWN. A circuit breaker permitted to remain in an intermediate position could result in control circuits being improperly connected, resulting in electrical failures.

Qualified personnel

For the purpose of operating and maintaining power circuit breakers, a person should not be considered qualified if the individual is not thoroughly trained in the operation of the circuit breaker and how it interfaces with the assembly in which it is used. In addition, the individual should have knowledge of the connected loads.

For the purpose of installing and inspecting circuit breakers and their associated assembly, a qualified person should also be trained with respect to the hazards inherent to working with electricity and the proper way to perform such work. The individual should be able to de-energize, clear, and tag circuits in accordance with established safety practices.

General information

The series NRX range of low voltage power (air) circuit breakers and switch-disconnectors are designed, manufactured, and tested for use in both switchboard and metalenclosed switchgear assemblies in accordance with UL489 and IEC 60947-2 requirements. The series NRX range is manufactured and tested in an ISO 9001 certified facility.

Series NRX circuit breakers and switch-disconnects are available in fixed and drawout mounting configurations and offer a variety of different connection solutions. The fixed configuration is designed for rear bus connections. The drawout version, in conjunction with its drawout cassette, is a through-the-door design having three breaker positions with the compartment door closed (CONNECT, TEST, DISCONNECT) and one position out of its compartment on extension rails (WITHDRAWN). A drawout cassette is also designed for rear bus connections. Continuous current ratings from 800 - 4000 A and interuption capacities up to 105 kA are available depending on the applicable standard. All series NRX circuit breakers are 100 percent rated.


Product labeling and identification

The circuit breaker nameplate, located on the right side of the breaker, provides complete rating information and should always be inspected to ensure the information shown is in keeping with the product ordered (Figure 1). Become familiar with the nameplate.



Series NRX circuit breakers should not under any circumstances be applied outside their nameplate ratings. Operation outside of these ratings could result in death, bodily injury, or property damage.

Figure 1. Series NRX nameplate location.

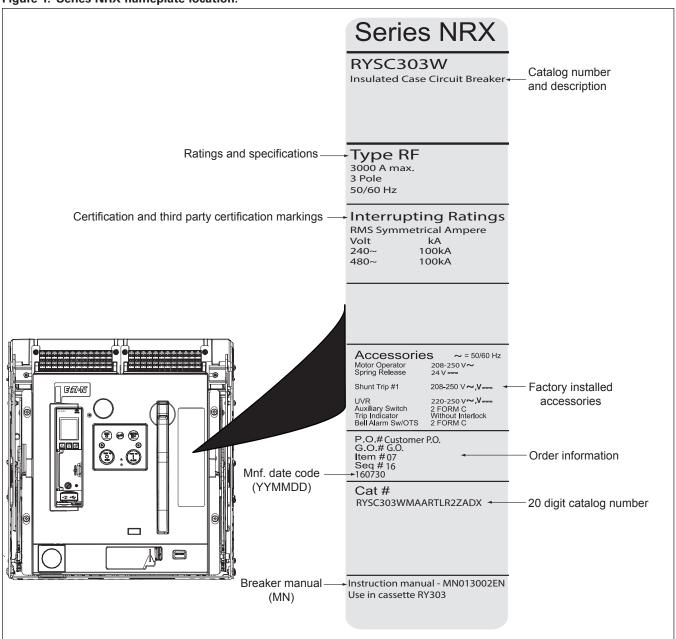

The circuit breaker configuration is fully described by a 20-digit catalog number located on the name plate. The drawout cassette can be identified by a 14-digit catalog number. An overview of the Catalog number code can be found in the catalog at www.eaton.com/seriesnrx. Individual circuit breakers are identified by the order information: G.O., Item, and Sequence numbers. Taken together, these are equivalent to a serial number

Breaker overview

Figures 2 through 5 highlight the main components that make up a series NRX breaker.



The circuit breaker mechanism contains stored mechanical energy and moving parts and should be operated with the front cover and arc chutes in place. Parts may move forcefully and without warning. If the front cover or arc chutes have been removed, limit contact to the handle and buttons. Failure to do so may result in serious bodily injury.

Drawout breaker and cassette

A drawout circuit breaker is used in combination with a drawout cassette (Figures 2 and 3). Mounted on the drawout breaker are the primary disconnect finger clusters and levering mechanism. These components are located on the breaker to allow Users easy access when performing product inspection or maintenance. The cassette provides all the necessary drawout circuit breaker interfaces, including primary and secondary connections. Standard flat terminal pads on the rear of the cassette provide for a variety of primary connection configurations. Optional primary adapters are available for front and rear bus or cable connections. For specific details and mounting instructions for primary adapters, refer to www.eaton.com/seriesnrx.


Fixed circuit breaker

A fixed circuit breaker is rigidly mounted in its structure with no drawout feature. The circuit breaker is available in front and rear-connected configurations (Figure 4).

The breaker can be mounted on a suitable horizontal mounting surface using left and right-side mounting feet. A standard fixed circuit breaker is supplied with flat primary terminal pads on the rear of the breaker that will accommodate a variety of primary connection configurations.

Refer to Section 5 and 6 for mounting and installation dimensional information. Electronic files of dimensional drawings for customer use are available for download at www.eaton.com/seriesnrx.

Figure 2. Typical NRX type RF drawout circuit breaker.

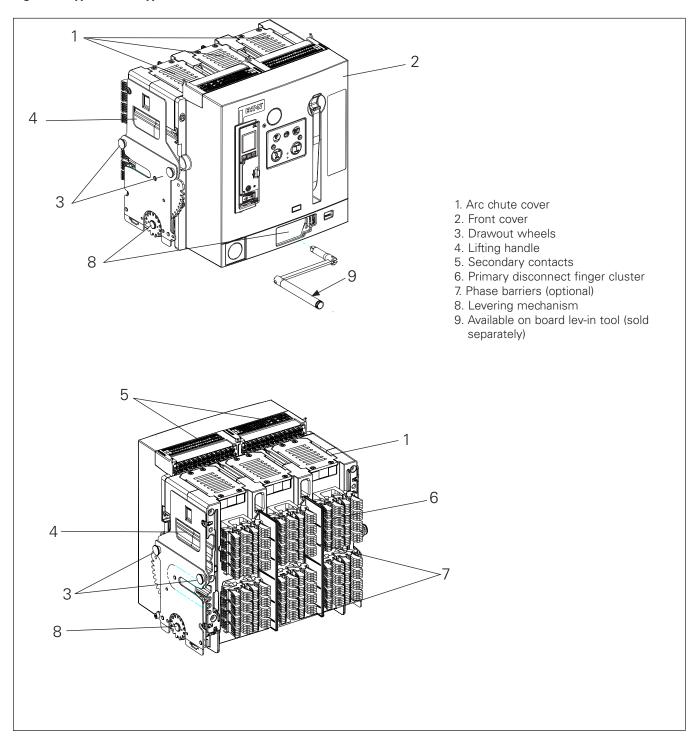

Note: Refer to Figure 5 for more visual details of front cover.

Figure 3. Typical NRX type RF drawout cassette.


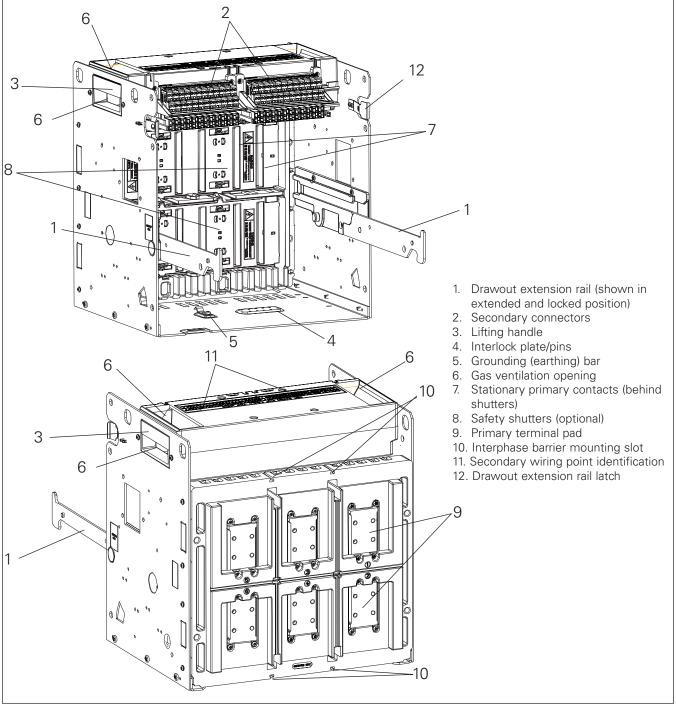


Figure 4. Typical NRX type RF fixed circuit breaker.

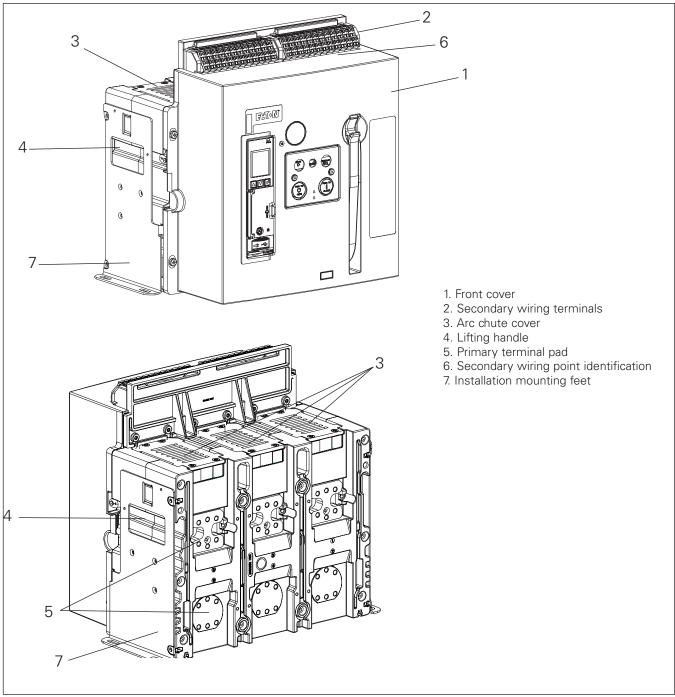

Note: Refer to Figure 5 for more visual details of front cover.

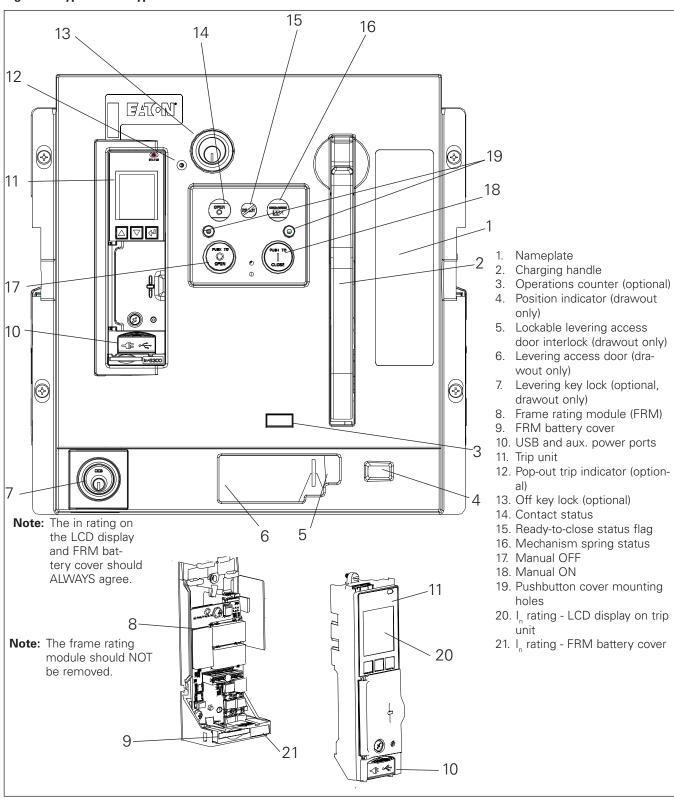


Figure 5. Typical NRX type RF drawout circuit breaker front cover.

Section 2: Receiving, unpacking, and inspection

Suggested tools


- Flat-blade/Phillips head screwdrivers
- 3/8-inch levering tool or extension/ratchet
- 5 mm Allen head screwdriver
- 1/2 inch socket and ratchet or 1/2 inch wrench

Circuit breaker unpacking and inspection

Inspect shipping containers for obvious signs of external damage. Record any observed damage for reporting to the transportation carrier and Eaton. All reports and claims should be as specific as possible and include the order number and other applicable nameplate information.

Note: The outside of the circuit breakers shipping container includes a transport "Tip-N-Tell" indicator alerting the receiver as to whether or not the shipping container was transported and handled in the required manner. Refer to Flgure 6 for details about the indicator before removing the circuit breaker from its container.


Figure 6. Transport indicator.

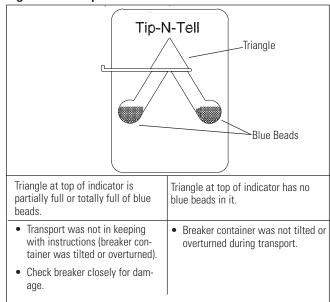

When ready to inspect and/or install a Series NRX circuit breaker, proceed with the following steps:

Step 1: Carefully open container and remove all packing/shipping material and documentation.

Figure 7. Step 1.

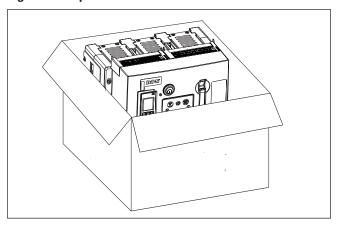

Note: Also follow Step 1 when handling a separately shipped drawout cassette.

Step 2: Save all packing/shipping material and documentation for future shipments or breaker storage purposes.


Step 3: Move the breaker to a convenient place for closer examination. Drawout breakers are provided with a lifting handle on both sides to assist lifting.

Use an appropriate device to lift the breaker or cassette (Figure 9). If one is not available, it is recommended that a minimum of two people be used to lift/move a breaker or cassette.

Note: Refer to Figure 9 for additional precautions and lifting procedures.

Step 4: Repeat Step 3 for a drawout cassette. The cassette is provided with a lifting indentation on each side.

Figure 8. Step 3.

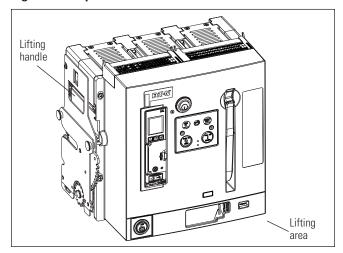


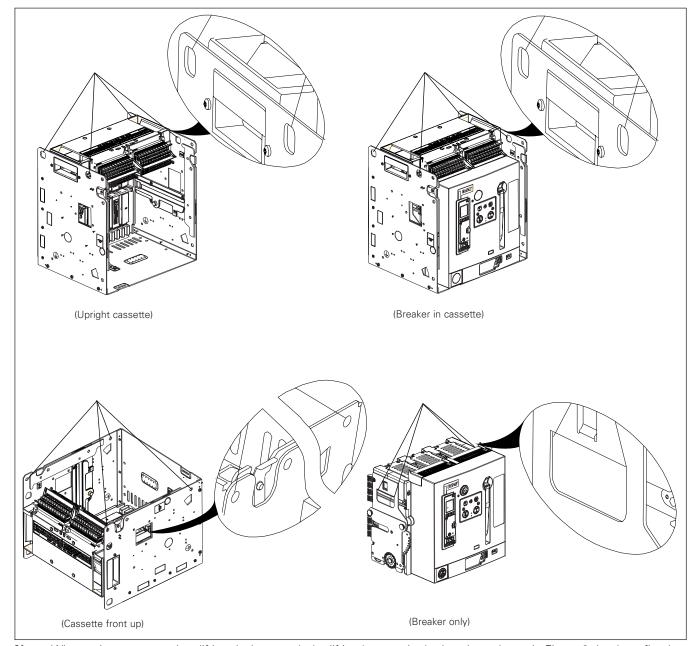


Figure 9. Suggested lifting procedures and precautions

Note: When using an appropriate lifting device, attach the lifting harness in the locations shown in Figure 9 that best fits the circumstances.

Figure 10. Step 3.

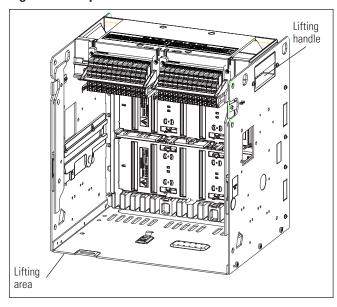

Step 5: Carefully place a breaker or cassette on a solid work surface capable of handling their weight for examination (Table 1). A drawout circuit breaker can also be examined while withdrawn on the drawout extension rails of an already installed cassette. Fixed circuit breakers already installed in an assembly can be inspected in their installed location.

A CAUTION

Do not attempt to lift a breaker or cassette with ordinary crane hooks or chains. Damage to vital circuit breaker parts could result. Use two appropriate lifting straps when using any type of lifting device.

CAUTION

Make certain that the cassette is properly mounted or seated securely on a work table before attempting to have the breaker fully extended on the cassette's drawout rails. Failure to comply could result in the cassette tipping forward resulting in equipment damage and/or bodily injury.

Table 1. Approximate weights.

Item	Lbs	Kg
Drawout breaker, three-pole	145	66
Drawout breaker, four-pole	180	82
Fixed breaker, three-pole	120	55
Fixed breaker, four-pole	155	71
Drawout cassette, three-pole	66	30
Drawout cassette, four-pole	78	35

Circuit breaker inspection

All circuit breakers, once removed from their shipping containers, should be visually inspected for any obvious damage. Check to make sure that the installed trip unit and nameplate information match the equipment as ordered. All circuit breakers should be operated as described in Section 3 prior to being put into service.

Storing circuit breaker

Store a circuit breaker in its original shipping container with contacts open and springs discharged. Keep it in a clean dry place. Ensure there is ample air circulation and heat, if necessary, to prevent condensation.


! IMPORTANT

A circuit breaker stored for any length of time should be operated a minimum of five times before it is placed in service.



Do not store equipment on its back. This could result in equipment damage.

Figure 11.

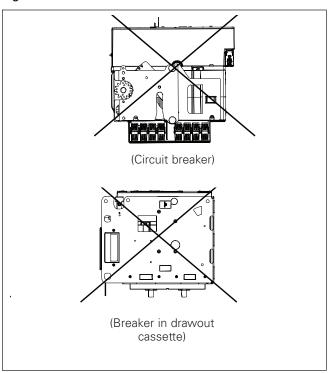

Section 3: General operation and circuit breaker description

Introduction



CAUTION

Make certain that the cassette is properly mounted or seated securely on a work table before attempting to have the breaker fully extended on the cassette's drawout rails. Failure to comply could result in the cassette tipping forward resulting in equipment damage and/or bodily injury.

Series NRX low voltage circuit breakers are available in both drawout and fixed mounting configurations (Figure 2 and Figure 4) as three-pole or four-pole breakers.

All circuit breakers should be operated manually and/or electrically before they are put into service. This can be done during the installation process or some later date prior to startup.

Installing the drawout circuit breaker in the cassette

In a structure equipped for a drawout circuit breaker, a bolted-in cassette with movable, captive extension rails supports the circuit breaker.




CAUTION

It is important to take care when placing a drawout circuit breaker on its extension rails. If the circuit breaker is not properly seated on the rails, the breaker could fall causing equipment damage and/or bodily injury.

To install the drawout circuit breaker, proceed first with the following four steps.


Step 1: Press the extension rail spring away from the extension rail until the retaining pin is fully released. Each drawout rail is provided with a curved cutout to accommodate a gloved hand.

Figure 12. Step 1.

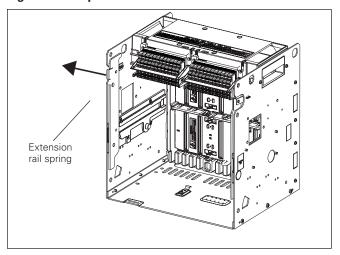


Step 2: Lower both rails down into their extended and locked position.

Figure 13. Step 2.

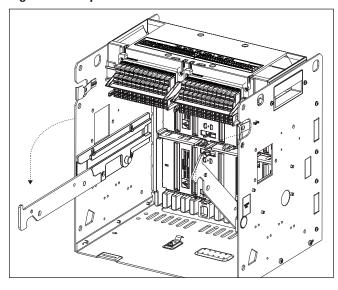

Step 3: Carefully place the circuit breaker on the extended rails. Be certain that the circuit breaker's metallic support wheels (two on each side of the circuit breaker) are properly seated on the extension rails. With breaker properly seated on the extension rails, slide the breaker fully into the cassette and raise both rails up into the cassette so that they engage the extension rail spring. The breaker is now in the cassette in the DISCONNECT position.


Figure 14. Step 3.

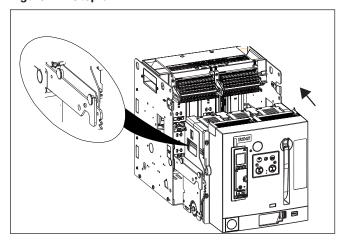

Keep in mind that all drawout circuit breakers are provided with safety interlocks to prevent inserting circuit breakers into incompatible drawout cassettes. Do not force a circuit breaker that does not roll smoothly into the cassette.

Step 4: To remove the breaker from the cassette lower both rails down into their extended and locked position. Using the charging handle pull the breaker out onto the extension rail

Figure 15. Step 4.

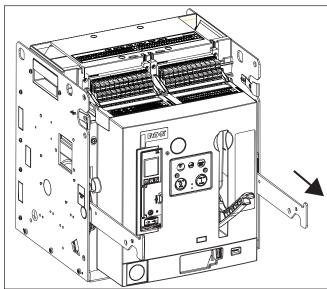

Rejection interlocks

Series NRX drawout circuit breakers come in a variety of continuous current and interrupting ratings. To prevent the insertion of a drawout circuit breaker into a cell with which it is incompatible, rejection interlock key plates are provided for both the circuit breaker and the cassette. One key plate is located on the bottom of the circuit breaker and one is located on the floor of the cassette. Rejection pins must be installed in both plates to complete the interlock scheme.

The switchboard builder is responsible for installing the rejection pins in the appropriate pattern in the rejection plates on both the circuit breaker and cassette. A rejection pin installation kit, including the instruction leaflet IL01301006E, is available from Eaton for this purpose.

A

WARNING

Never attempt to disable any interlocks. Doing so could result in an electrical fault that could result in death, bodily injury, and/or equipment damage.

Drawout circuit breaker positioning

Series NRX drawout circuit breakers have four normal positions:

- WITHDRAWN (Figure 16);
- DISCONNECT (Figure 17);
- TEST (Figure 18); and
- CONNECT (Figure 19).

The WITHDRAWN position is outside the compartment on the cassette's drawout rails. The DISCONNECT, TEST, and CONNECT positions are reached by means of the levering mechanism and can be achieved with the assembly door closed.

Figure 16. WITHDRAWN position.

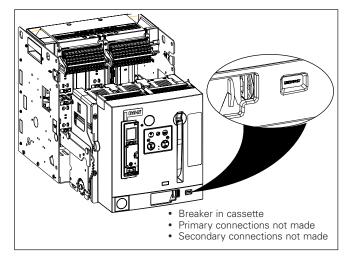


Figure 17. DISCONNECT position.

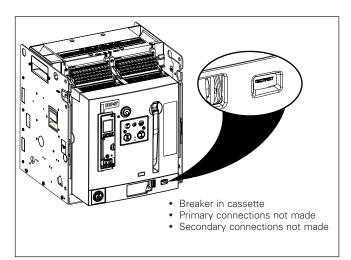


Figure 18. TEST position.


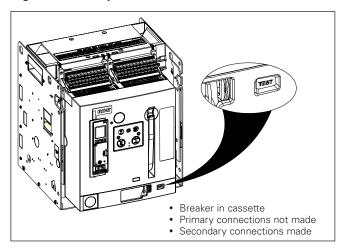


Figure 19. CONNECT position.

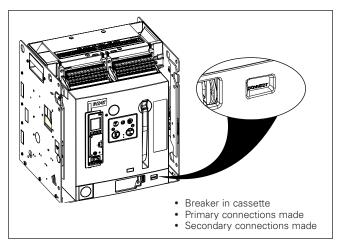

With the circuit breaker sitting solidly on the extension rails in its WITHDRAWN position, proceed with the following five steps to move the circuit breaker through its other positions.

Step 1: Make sure the circuit breaker position indicator, located in the right lower portion of the circuit breaker, indicates DISCONNECT (Figure 17).

Step 2: If the indicator window indicates anything other than DISCONNECT, use the breaker's on board tool (racking tool) or 3/8 in. extension and ratchet to get the circuit breaker in the proper levering position. Open the levering access door by sliding it to the left. Insert the levering tool into its compatible front accessible fitting, and rotate it counterclockwise until DISCONNECT is indicated in the window. An audible "click" may be heard. This is the levering-in's detent system engaging, which provides positive feedback when the device is in each discrete position.

Note: The Detent will engage at each discrete position (DISCONNECT, TEST, CONNECT) and requires the user to manually reset the system before proceeding to the next position.

Figure 20. Step 2.



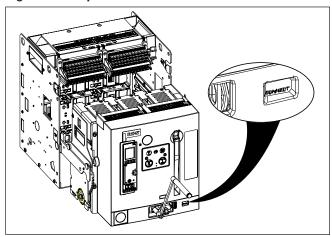


Figure 20a. Step 2.

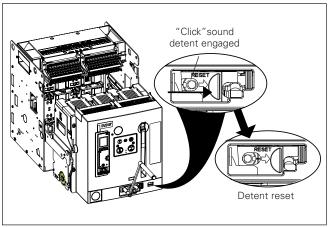

Step 3: Carefully push the circuit breaker into its compartment until it stops. The extension rails can now be folded up and latched

Figure 21. Step 3.

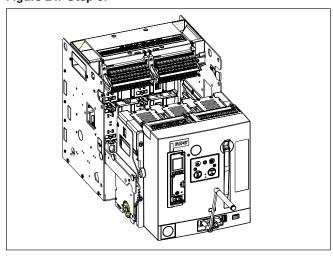


Step 4: The breaker is ready to be levered. With the circuit breaker OPEN, reset the detent system by sliding the grey button to the right, then release (Figure 20a). Rotate the levering tool clockwise to the different available positions (DISCONNECT, TEST, CONNECT).

Note: The position indicator on the lower right portion of the breaker indicates the position as each position is reached. The levering detent system will also engage, stopping breaker travel.

When the breaker reaches the CONNECT position, a hard stop is encountered. Discontinue levering to avoid damage due to torquing beyond the maximum of 15 ft-lbs (20.3 N•m).

Figure 22. Step 4.

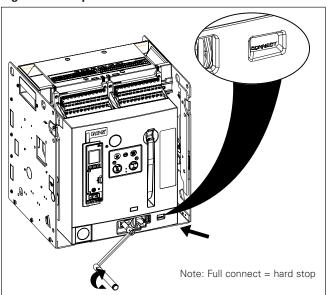

Step 5: To remove the circuit breaker from any position or from the compartment completely, reverse the insertion procedure just described in Steps 1 through 4 by rotating the levering tool in a counterclockwise direction. When the DISCONNECT position is reached, the circuit breaker will no longer move out of the cassette as a result of rotating the levering tool. At this point, the circuit breaker can be pulled out of the cassette onto its drawout rails.

!\


IMPORTANT

The circuit breaker mechanism is interlocked such that charged closing springs are automatically discharged if the circuit breaker is levered into or out of the cell. Discharge takes place between the DISCONNECT and TEST positions.

Installing fixed circuit breaker

A fixed circuit breaker is solidly mounted in its structure with no drawout feature. The circuit breaker is available in rear-connected configurations (Figure 23) and can be mounted on a suitable horizontal mounting surface using left- and right- side mounting feet. Refer to Section 6 for breaker and primary bus stab details and requirements.

Figure 23. Fixed breaker.

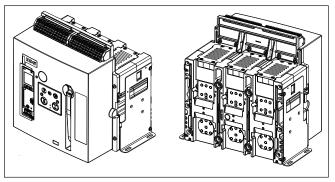

Basic circuit breaker assembly

Series NRX circuit breakers use a rigid frame composite housing construction. This construction provides high-strength structural properties, excellent dielectric characteristics, and arc tracking resistance. They are available with various connection configurations and specific ratings dictated by the applicable standards (see www.eaton.com/seriesnrx.)

Each pole has one primary contact assembly comprised of a moving portion and a fixed portion. The exact design configuration depends upon the breaker's frame size and interruption rating.

Operating mechanism

The series NRX operating mechanism is a two-stage stored energy trip-free mechanism. Energy is stored for a closing operation with sufficient energy remaining to open the circuit breaker after a closing operation.


All circuit breakers should be operated manually and/or electrically before they are put into service. This can be done during the installation process or some later date prior to startup. To perform this operational check, follow the procedures outlined in this section.

Manual operation

On manually operated circuit breakers, the closing spring must be charged by hand. To manually charge the spring and operate the circuit breaker, proceed with the following three steps:


Step 1: Insert one finger in the curved recess behind the charging handle and pull out and down.

Figure 24. Step 1.

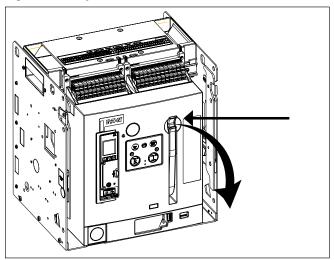

Step 2: It takes approximately seven full downward strokes to complete the charging process. It is possible to manually recharge the spring immediately after closing the breaker, before it has been tripped open. The status of the spring (charged or discharged) is indicated in the mechanism spring status window just above the pushbuttons.

Figure 25. Step 2.

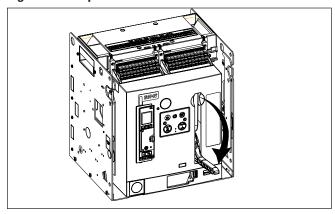

Step 3: Standard manually operated circuit breakers are closed and opened by hand using the Manual ON and Manual OFF buttons located on the front of the circuit breaker. To perform either operation, press and release the appropriate button. Pressing the close button will not close the breaker unless the Ready-to-Close flag displays ready. The Ready-to-Close flag is adjacent to the spring status flag. The Ready-to-Close flag will display not-ready if the breaker is closed, not fully charged, or held in the tripped state by an accessory or interlock. The status of the contacts (open or close) is indicated in the Contact Status Window just above the pushbuttons on the front of the breaker.

Figure 26. Step 2.


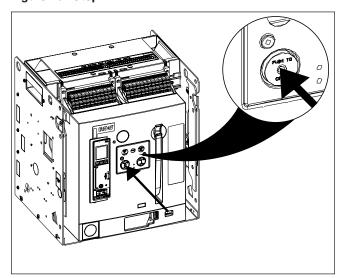


Figure 27. Step 3.

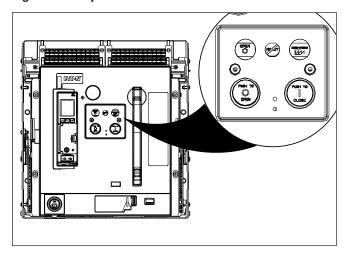

Optional electrically operated accessories are available to automatically close/trip a manually operated breaker.

Electrical operation

The springs on an electrically operated circuit breaker are normally charged automatically through the use of an electrical operator. The springs can, however, be charged manually as just described in the last section. Electrically operated circuit breakers can also be manually closed and opened through the use of the front mounted ON and OFF buttons.

An electrically operated circuit breaker can be equipped with an optional spring release (closing coil) to close the circuit breaker remotely. The breaker can also be equipped with a shunt trip (opening coil) to open the breaker remotely.

! IMPORTANT

Different degrees of access to pushbuttons on the front of the circuit breaker can be achieved through the use of optional accessory devices.

Anti-pump Feature

Series NRX circuit breakers have both mechanical and electrical anti-pump features. If the circuit breaker is closed on a fault condition and trips open while the CLOSE signal is maintained (using either the mechanical pushbutton or the electrical close coil), it will not make a subsequent attempt to close until the close command is removed and reapplied.

Note: If the close signal is applied prematurely (before the breaker is completely charged and latched), the close command will be ignored until it is removed and reapplied.

For electrical closing, a Latch Check Switch (LCS) option is available that will block the application of the electrical close command until the breaker is ready.

Section 4: Circuit breaker features and accessories

Introduction

The features and accessories of the drawout and fixed configurations are covered briefly in this section. Details and installation instructions on trip units and individual accessories are covered in their respective IL's.

Arc chambers

An arc chamber, one for each pole, includes an arc chute mounted around a set of primary contacts. The chambers act to quench arcs and channel gases up and out of the breaker during interruption.

Electronic tripping system

Series NRX circuit breakers use a three-part tripping system:

- Microprocessor-based trip unit connected to a frame rating module;
- · Rogowski coil type current sensors; and
- Trip actuator.

All three parts of the tripping unit are discussed here in general. For detailed information pertaining to the different available trip unit models and other breaker or accessory information, refer to Eaton's website www.eaton.com/seriesnrx.

See important frame rating module information on next page regarding the tripping system.

Microprocessor-based trip unit

Series NRX circuit breakers utilize the PXR family of electronic trip units whose main features are summarized in Table 2. Digitrip trip units are still available for purchase on IEC breakers.

The electronic trip units are self-powered devices (Figure 24). The protection settings can be set from the front panel. When the circuit breaker is closed, no external power is required to operate their protective systems. Current signal levels and the control power are derived from the current sensors. All trip units are true RMS current sensing devices.

A functional local test of the trip unit's primary electronic circuitry and the circuit breaker's mechanical tripping action can be performed through the trip unit's USB receptacle (Figure 5).

Figure 28. Installed PXR trip unit.

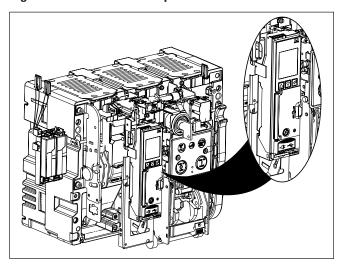


Table 2. Series NRX trip units.

Functions	PXR20	PXR 25
LSIG protection	Yes	Yes
Disable (I)	Yes	Yes
GF protection	Option	Option
GF alarm	Option	Option
Display	Yes	Yes
Programmable	No	No
Current metering	Yes	Yes
Power/energy metering	No	Yes
Power quality metering	No	No
Communication	Yes	Yes

Rating plug

A rating plug is not required with PXR trip units. See frame rating module description.

Current sensors

Rogowski coil type current sensors are installed on the load terminals at the bottom rear of the circuit breaker. The sensors furnish the trip unit with a signal and the energy required to trip the circuit breaker.

An external neutral current sensor is available for customer installation, and must be ordered separately.

Frame rating module

The PXR frame rating module is mounted just behind the trip unit and stores data related to the breaker's ratings (including the maximum continuous RMS current), manufacturing information, and health of the breaker frame.

The interchangeable trip unit attaches to the permanent frame rating module. Since the PXR trip unit no longer requires a fixed type rating plug, the continuous current (In) rating is factory programmed in the frame rating module.

The programmed value of I_n is shown on the trip unit's LCD display and printed on the Battery cover at the lower right corner of the trip unit. The In rating displayed and programmed will be equal to or less than the breaker frame's maximum rated current as listed on the nameplate in Figure 1.

The breaker's I_n rating can be re-programmed by interfacing with the USB port on the trip unit. Please contact your Eaton sales representative for details on proper re-programming of the trip unit.

Frame rating modules installed on series NRX air circuit breakers with PXR are permanent and SHOULD NEVER BE REMOVED. The frame rating module battery cover with printed In rating (see Figure 7) should not be changed without proper reprogramming of the trip unit. The In rating programmed from the factory is displayed in the lower left hand corner of the LCD screen whenever power is applied to the trip unit. The In displayed on the LCD reflects the actual In rating of the breaker, while the value on the battery cover is for reference only when the LCD is not powered. The In rating displayed on the LCD screen and In rating printed on the frame rating module battery cover MUST ALWAYS AGREE. See MN013003EN for more information.

Trip actuator

The low-energy trip actuator is a small electromagnetic device that provides the necessary mechanical force to initiate the tripping action of the circuit breaker. The electronic trip unit provides a pulse to the coil of the trip actuator, allowing the mechanical tripping action to take place. The trip actuator is reset by the operating mechanism.

Fixed high instantaneous non-adjustable trip

Series NRX circuit breakers have a fixed instantaneous non-adjustable setting. This fixed instantaneous trip will initiate a trip at a high current peak which depends on the circuit breaker type and rating. This setting is always active, regardless of the instantaneous setting.

Non-automatic device

Series NRX is available in a non-automatic configuration. It is derived from the corresponding NRX automatic breaker but does not include the trip unit, Rogowski coil type current sensors, and the high instantaneous trip feature. The overall dimensions and the capability of mounting most accessory items are maintained. Non-automatic device are tested in keeping with UL489 and IEC 60947-2 requirements.

Figure 29. Secondary point identification.

																			P)	Χŀ	3	RIP) (J۱	۱I	T	S																			
1 3 5 + + IMN	0T18	OT2C 60	11	NLMC 13	15 ALM2	17 5	19 454v	21 N	23 wooz	25 cww1	27 CMM3	PTVA AVT9	31	MODBA 53	35 pagow	37 SCMM3	2CMM1 68	ARCON2 1	43	45	47		49 337		53 + 103	SR1	57 5	59 E	61	63 හ	65 8		69 53	71 %	73 93	75 20	77 %		81 ප	83 £	010					95
I 2X12 2X10 4 6	∞ 0T2B	MZ10 10	일 12	µµ 14	91 ALM3	ଞ 18			лог 24		28 CMM4		NALI 32				04 ARCON1	ENCONA 42	2H 44	46	48		₩ 50	် 52	от 54	56 SH2	¥ 58			₽ 64	ă ≅	₹ 68	99 70	% 72	9v 74	76	æ 78	æ 80	82 82	윤 84	86 A10	88 89 B	90 BH2	26 A12	94	96
								(L	eft	side	e)																					(Rig	ght	sid	e)										

Secondary contacts and connection diagrams

A maximum of 96 secondary wiring connection points are available, each dedicated to specific functions. The number of secondary blocks mounted depends on a number of considerations, such as whether the circuit breaker is electrically or manually operated and how many features are required. All necessary customer secondary connection point are accessible without removing the breaker's front cover. Each connection point is permanently identified.

The customer secondary wiring contact point map is identifiable on the product (Figure 29). For a drawout breaker, this marking is laser etched into the arc hood of the drawout cassette (Figure 2). For a fixed mount breaker, this is a label applied to the top of the front cover of the breaker (Figure 4)

The connection diagram and specific secondary contact information for the Series NRX circuit breakers using PXR trip units can be found in the Series NRX Wiring Diagram document TD013001EN.

Table 3. Series NRX wiring index (TD01301014E).


Wiring topic

Zone interlock wiring	Figure 1
Ground fault residual 3-phase 4-wire	Figure 2
Source ground fault sensing	Figure 3
Zero sequence ground fault sensing	Figure 4
PXR alarm wiring	Figure 5
Maintenance mode wiring	Figure 6
INCOM communication module (ICAM)	Figure 7
MODBUS communication module (MCAM)	Figure 8
PROFIBUS communication module (PCAM)	Figure 9
ETHERNET communication module (ECAM)	Figure 10
Remote control (SR and ST wiring)	Figure 11
Undervoltage release	Figure 12
Circuit breaker control- type NF frame	Figure 13
Circuit breaker control -type RF frame	Figure 14
Series NRX breaker with external PT module	Figure 15
Typical breaker master connection diagram - NF	Figure 16
Typical breaker master connection diagram- RF	Figure 17

General wiring notes

 Each secondary terminal block contains four independent contacts (Figure 30). A possible 24 terminal blocks will provide 96 contact points for the type RF frame.

Figure 30. Secondary point identification.

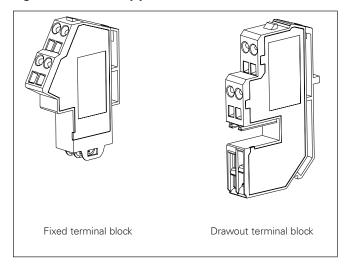

- Drawout circuit breakers use Style 67C3246 contact blocks that mount onto an insulated support frame on the cassette.
- 3. Fixed mounted circuit breakers use Style 67C3247 contact blocks that mount onto an insulated support frame. The customer tension connectors are at an angle.
- 4. Customer wiring is done using a tension clamp termination on each contact.
- Contact blocks are individually mounted and hence contact positions may be empty depending on accessories and options ordered.
- The tension clamp terminals will support solid or flexible conductors, #12/4 mm² through #26 /0.5 mm² AWG and are UL/CSA rated for 600 V, 10 A for IEC, 5 A for UL or CSA (18 AWG minimum) continuous current.¹.
- 7. The recommended wire strip length is 10-12 mm (0.39 0.47 in.).

¹ Revised Effective 11/21/22

- 8. The tension clamp terminals also support finely stranded conductors with wire-end ferrules and plastic collars DIN 46228/4, rated connection.
- 9. The two-point blue plugs house two female crimp contacts 67C3249, with the odd assigned numbers having the coded rib feature on the blue plug.
- For secondary contacts, odd numbers should be treated as positive voltage for any accessory. This will not apply for AC ratings

Table 4. Customer wiring details.

Type of conductor	Tension clamp connection	Recommended strip length or ferrule length						
Solid cross section (min - max)	0.5 - 4 mm ²	10 - 12 mm (.3947 in.)						
Flexible cross section (min - max)	0.5 - 4 mm ²	10 - 12 mm (.3947 in.)						
American wire gauge - AWG (min - max)	26 - 12 AWG	10 - 12 mm (.3947 in.)						
Flexible cross-section with wire end ferrule with- out plastic sleeve - DIN 46228/1 (min - max)	0.52.5 mm ² (26 - 14 AWG)	10 - 12 mm (.3947 in.)						
Flexible cross-section with wire end ferrule with plas- tic sleeve - DIN 46228/4 (min - max)	0.5 - 1.5 mm ² (26 - 16 AWG)	16 - 18 mm (.6371 in.)						
Gauge to IEC 60947-1	A3	-						

Accessory devices

A variety of accessory devices are available for use with Series NRX circuit breakers. Unless otherwise stated, they are all considered optional devices in the sense that they are not provided as standard on a manually operated circuit breaker. Available accessories are discussed in general terms. For more detailed information and/or installation instructions, refer to individual instruction leaflets dedicated to individual items.

Series NRX circuit breaker accessories are designed to be field installed. The accessories fall into one of three categories:

- · Accessory tray devices
- Other internal electrical devices
- Mechanical devices

Accessory tray devices

Certain accessory devices are mounted in an accessory tray. The tray is then installed in a left- or right-hand slot located in the upper left- and right-hand sides of the circuit breaker (Figure 31 and Figure 32).

Figure 31. Left accessory tray.


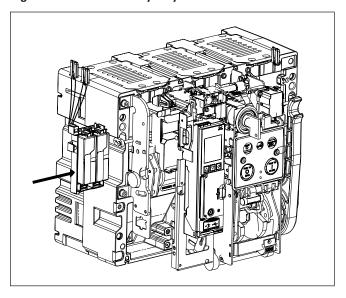


Figure 32. Right accessory tray.

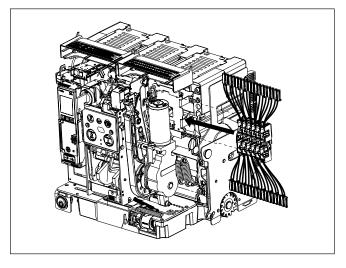

Left accessory tray

The left accessory tray will accommodate a maximum of four optional devices as follows:

- One, or two shunt trips (ST);
- One undervoltage release (UVR); or
- Combination (one ST and one UVR); and
- Two overcurrent trip switches (OTS).

Right accessory tray

The right accessory tray will accommodate up to six sets of 2a/2b auxiliary switch combinations.

Shunt trip (ST)

The shunt trip opens the circuit breaker instantaneously when its coil is energized by a voltage input.

Undervoltage release (UVR)

The undervoltage release opens the circuit breaker when its supply voltage falls into the range of 35 – 60% of rated voltage. If the release is not energized to 85% of its supply voltage, the breaker cannot be closed electrically or manually.

Overcurrent trip switch (OTS)

An overcurrent trip switch (bell alarm) provides an electrical indication when a circuit breaker trips as a result of the trip unit. Opening as a result of a circuit breaker's manual open button, shunt trip, or undervoltage release does **not** cause the overcurrent trip switch to operate. Overcurrent trip switches are available in two switch combinations only.

Auxiliary switch

An auxiliary switch provides remote electrical indication if the circuit breaker is open or closed. Each switch has one normally open ("a" contacts with the same state as the breaker contacts) and one normally closed ("b" contacts with the opposite state of the breaker contacts) type contact. Auxiliary switches are available in two switch combinations only.

Other internal electrical devices

Internally mounted electrical devices which do not utilize the accessory trays include:

- Spring release;
- · Latch check switch; and
- Motor operator.

Spring release (SR)

The spring release (closing coil) remotely closes the circuit breaker when the coil is energized by a voltage input. The spring release activates momentarily when voltage is first applied, and voltage must be removed in order to reset the spring release to activate again. When the spring release is used in conjunction with a Spring Release Latch Check switch and voltage is maintained to the spring release, activation of the spring release is delayed until the closing spring is fully charged and the trip latch is reset (not held in the tripped position). After these conditions are met and the spring release has activated, voltage must be removed to reset the spring release to activate again.

Latch check switch (LCS)

A latch check switch (LCS) indicates when the circuit breaker is "ready to close" (charged and not held tripped). Two versions of the LCS are available:

- The "spring release LCS", wired directly to the spring release, will not permit activation of the spring release until the circuit breaker is fully charged and the trip latch is reset.
- The LCS for Remote Indication consists of one Form C contact wired to the circuit breaker secondary contacts for integration into external control schemes.

Note: Wiring the LCS for remote indication directly in series with the SR accessory is not recommended as this will override the electrical "anti-pump" feature of the spring release.

Motor Operator

A motor operator is an electric motor assembly internally mounted in the circuit breaker. It charges the closing springs electrically for remote or local operation. The motor operator can be factory or field installed.

Mechanical devices

The following are optional mechanical type accessories:

- Pop-out trip indicator, non-interlocked and interlocked;
- Operations counter;
- · Off key lock;
- Pushbutton cover;
- Prevent close cover;
- Lockout cover;
- Cassette safety shutters;
- · Door escutcheon;
- IP55 resistant cover; and
- · Mechanical interlock.

Non-interlocked pop-out mechanical trip indicator

A non-interlocking red mechanical trip indicator, located to the right of the trip unit on the breaker's front faceplate (Figure 5), operates by releasing and popping out any time the breaker trips due to an overcurrent condition. It will not prevent the breaker from being reclosed. The indicator is reset manually by pushing it back in.

An optional overcurrent trip switch (bell alarm) can be used in conjunction with the mechanical trip indicator. The overcurrent trip switch operates off the position of the mechanical trip indicator, and is reset when the indicator is reset.

Interlocked pop-out mechanical trip indicator

An interlocked, red mechanical trip indicator is an optional feature. It is located in the front of the breaker near the top and to the right of the trip unit (Figure 5). It operates by releasing and popping out any time the circuit breaker trips due to an overcurrent condition.

Note: The interlocked mechanical trip indicator will prevent the breaker from being reclosed until the red, popout indicator is reset or pushed back in.

The indicator is reset manually by pushing it back in, or remotely with the available accessory. If the interlocked indicator is not reset, the circuit breaker will not close until the indicator is pushed back in.

An overcurrent trip switch (bell alarm), discussed later in this section, that operates off the position of the mechanical trip indicator is also available.

Operations counter

The operations counter is a mechanical device used to indicate a record of the number of circuit operations. It can be viewed through the breaker's front cover (**Figure 5**).

Off key lock

The off key lock secures the circuit breaker in the OFF position. It can be viewed through the front cover (**Figure 6**). The customer supplies the key lock. The provisions are available for Kirk, Castell, Ronis, and CES.

Pushbutton cover

Padlockable covers are available to limit access to the ON and OFF pushbuttons.

Safe-off pushbutton cover

When padlocked, it maintains the OFF button in the actuated position, which prevents closure of the breaker.

Cassette safety shutters

Automatically operated insulating type safety shutters (Figure 3) are available for use with the drawout cassette to cover the fixed primary contacts when the circuit breaker is not in the CONNECT position. The shutters are activated by barriers which must be installed on the rear of the drawout breaker.

Door escutcheon

The door escutcheon is a molded frame used to seal the space between the circuit breaker and the compartment door cutout. It is supplied with a mounting gasket. Refer to IL01301012E for installation information.

IP55 dust and water resistant cover

A hinged dome-shaped waterproof cover attaches to the metal compartment door to provide protection for the circuit breaker.

Mechanical interlock

Mechanical interlocks are available to interlock the operation of two or three Series NRX circuit breakers. The mechanical interlock holds one or more circuit breakers tripped (prevents closure) when others are closed. Consult Eaton for details.

Publications

Table 5. Series NRX publications.

Description	Publication number	Frame
PXR 20/25 Trip Unit for Series NRX User Manual	MN013003EN	NF and RF
PXR 20/25 Trip Unit for Series NRX Screen Navigation Guide	IL0131128EN	NF and RF
Series NRX with PXR Circuit Breaker Wiring Diagrams	TD013001EN	NF and RF
Series NRX NF & RF Circuit Breakers with PXR 20/25 Trip Units - Time Current Curves	AD013001EN	NF and RF
Series NRX - Installation Instructions for Fixed and Drawout Breaker Door Escutcheon	IL01301012E	NF and RF
Series NRX Drawout Circuit Breaker and Cassette Rejection Interlocks	IL01301006E	NF and RF
Series NRX - Installation Instructions for IP55 Dust And Water-Resistant Cover	IL01301038E	NF and RF
Series NRX with PXR - Instructions for Auxiliary Switch	IL0131096EN	NF and RF
Series NRX with PXR - Instructions for Undervoltage Release, Shunt Trip, and Overcurrent Trip Switch	IL0131087EN	NF and RF
Series NRX with PXR - Instructions for Spring Release, Latch Check Switch, and motor Operator	IL0131088EN	NF and RF
Series NRX with PXR - Instructions for Secondary Terminal Blocks	IL0131093EN	NF and RF
Series NRX with PXR - Instructions for Source Ground and Zero Sequence Ground Sensor	IL0131089EN	NF and RF
Series NRX with PXR - Installation Instructions for Ethernet Communications Adapter Module	IL0131125EN	NF and RF
Series NRX with PXR - Instructions for PROFIBUS DP Communications Adaptor Module (PCAM)	IL0131092EN	NF and RF
Series NRX with PXR – Instructions for Modbus Communications Adapter Module (MCAM)	IL0131091EN	NF and RF
Series NRX with PXR – Instructions for INCOM Communications Adapter Module	IL0131124EN	NF and RF
Series NRX with PXR - Instructions for PT Module	IL01301074E	NF and RF
Time Delay Undervoltage Module for Use with Undervoltage Release in Eaton Circuit Breakers	IL5721B33	NF and RF
Series NRX with PXR - Instructions for Neutral Current Sensor - Type RF	IL0131094EN	RF

Table 5. Series NRX publications (continued).

Description	Publication number	Frame
Series NRX with PXR - Instructions for Neutral Current Sensor - Type NF	IL0131090EN	NF
Series NRX with PXR - Instructions for Cassette Cell Switch - Type RF	IL0131095EN	RF
Series NRX with PXR - Instructions for Cassette Cell Switch - Type NF	IL0131097EN	NF
Series NRX - Installation Instructions for Kirk Key Interlock Kit	IL01301039E	NF and RF
Series NRX - Installation Instructions for Ronis Key Lock Kit	IL01301040E	NF and RF
Series NRX - Installation Instructions for CES Key Lock Kit	IL01301049E	NF and RF
Series NRX - Installation Instructions for Castell Key Lock Kit	IL01301050E	NF and RF
Series NRX - Installation Instructions for Operation Counter	IL01301055E	RF
Series NRX - Installation Instructions for Operation Counter	IL01301011E	NF
Series NRX - Installation Instructions for Drawout Cassette IP20 Safety Shutters	IL01301044E	RF
Series NRX - Installation Instructions for Drawout Cassette IP20 Safety Shutters	IL01301013E	NF
Series NRX - Installation Instructions for Pushbutton Cover Kit	IL01301065E	RF
Series NRX - Installation Instructions for Pushbutton Cover Kit	IL01301041E	NF
Series NRX - Installation Instructions for Pop-Out Mechanical Trip Indicator	IL01301058E	RF
Series NRX - Installation Instructions for Pop-Out Mechanical Trip Indicator	IL01301019E	NF
Series NRX - Installation Instructions for Drawout Circuit Breaker 2-Way Cable Interlock Kit	IL01301059E	RF
Series NRX - Installation Instructions for Drawout Circuit Breaker 3-Way Cable Interlock Kit	IL01301060E	RF
Series NRX - Installation Instructions for Fixed Circuit Breaker 2-Way Cable Interlock Kit	IL01301061E	RF
Series NRX - Installation Instructions for Fixed Circuit Breaker 3-Way Cable Interlock Kit	IL01301062E	RF
Series NRX - Installation Instructions for Drawout Circuit Breaker 2-Way Cable Interlock Kit	IL01301069E	NF
Series NRX - Installation Instructions for Drawout Circuit Breaker 3-Way Cable Interlock Kit	IL01301070E	NF
Series NRX - Installation Instructions for Fixed Circuit Breaker 2-Way Cable Interlock Kit	IL01301071E	NF
Series NRX - Installation Instructions for Fixed Circuit Breaker 3-Way Cable Interlock Kit	IL01301072E	NF
Series NRX - Installation Instructions for Lev-In Key Interlocks	IL01301063E	RF
Series NRX - Installation Instructions for Fixed Breaker Arc Hood	IL01301014E	NF

Table 5. Series NRX publications (continued).

Publication number	Frame
IL01301066E	RF
IL01301073E	NF
IL01301048E	RF
IL01301053E	RF
IL01301056E	RF
IL0131123EN	NF
IL01301016E	NF
IL01301021E	NF
IL0131147EN	RF
IL0131150EN	RF
	IL01301066E IL01301073E IL01301048E IL01301053E IL01301056E IL0131123EN IL01301016E IL01301021E IL0131147EN

Section 5: Dimensional drawings for installation of drawout circuit breakers

General

Section 3 discussed topics and features common to all series NRX circuit breakers, no matter what the mounting configuration or type. In this section, features unique to the drawout type circuit breaker and drawout cassette not covered elsewhere are discussed.

Drawout cassette

A drawout circuit breaker (Figure 2) is used in combination with a drawout cassette (Figure 3). The cassette provides all the necessary drawout circuit breaker interfaces, including automatic primary and secondary connections. Standard flat terminal pads on the rear of the cassette provide for a variety of primary connection configurations. **Optional primary adapters are available for rear bus connections.** For specific details and mounting instructions, refer to IL01301053E. There are special adapters designed for NRX RF 4000A UL489. Refer IL0131147EN and IL0131150EN Refer to Figure 33 through Figure 50 for selected mounting and installation dimensional information. Complete dimensional and installation drawings are available from www.eaton.com/seriesnrx.

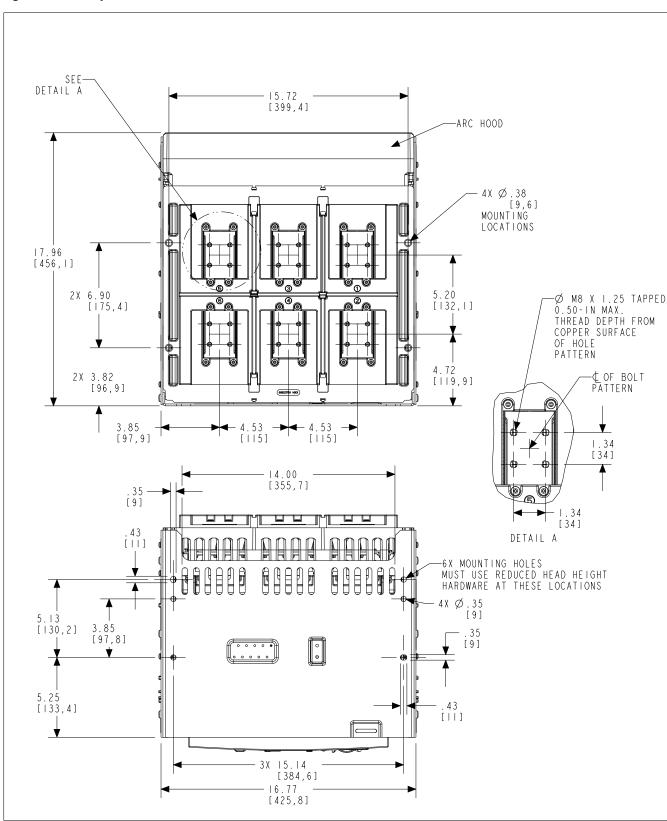


Figure 33. Three-pole drawout cassette - rear/bottom views in inches (mm).

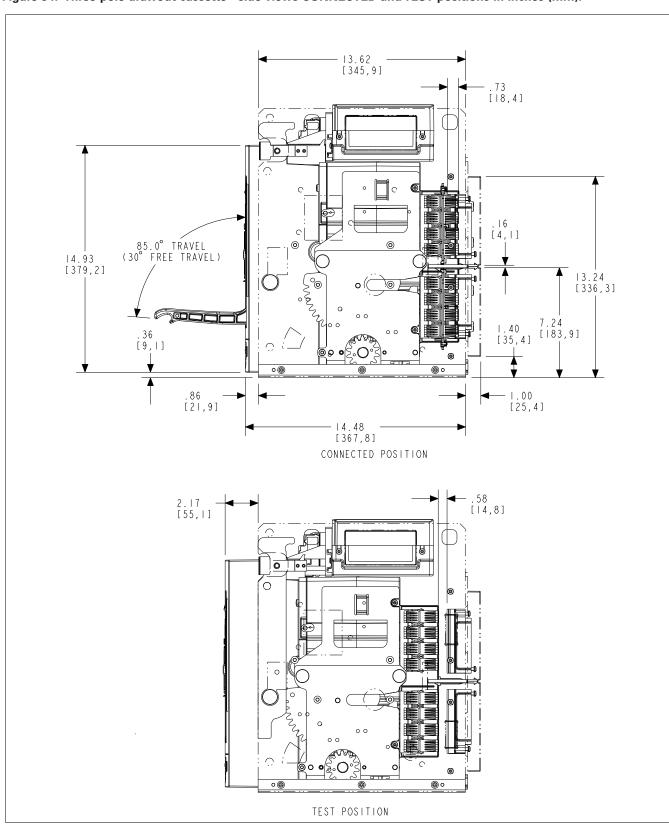


Figure 34. Three-pole drawout cassette - side views CONNECTED and TEST positions in inches (mm).

2.87 [72,9] 1.28 [32,6] 0 @ DISCONNETED POSITION 12.47 [316,7] **o** 0 🚳 WITHDRAWN POSITION |4.06 [357]

Figure 35. Three-pole drawout cassette - side views DISCONNECTED and WITHDRAWN positions in inches (mm).

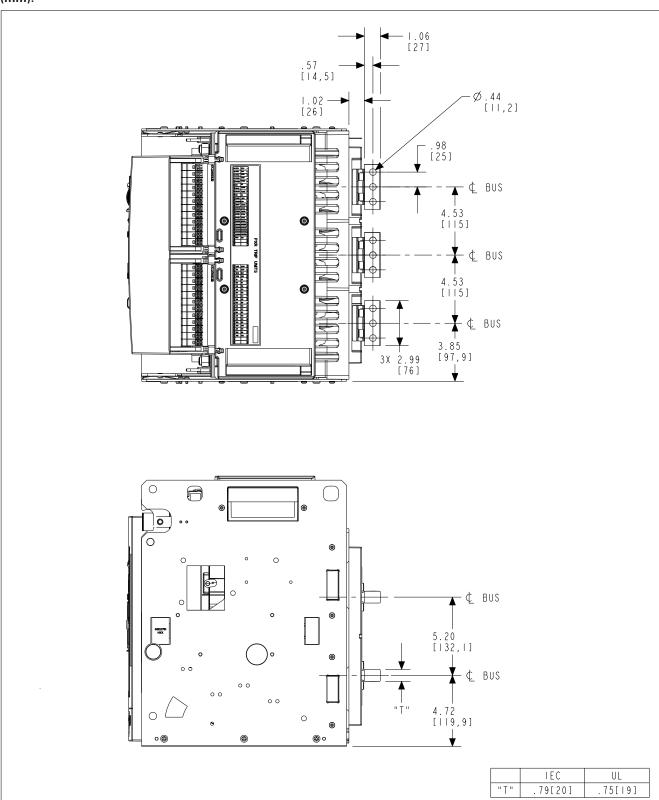
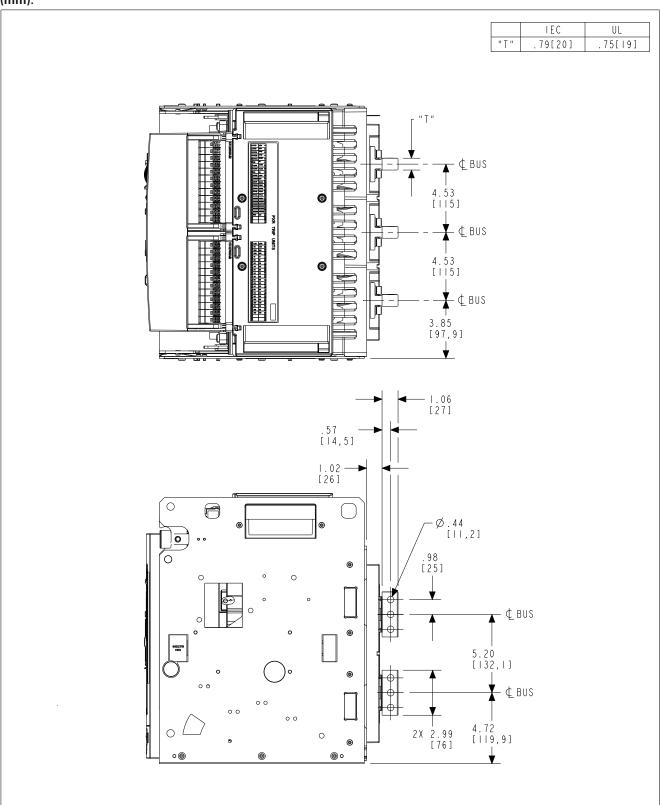


Figure 36. Three-pole drawout cassette - top/side views with centered three-hole horizontal bus adapters in inches (mm).

Figure 37. Three-pole drawout cassette - top/side views with centered three-hole vertical bus adapters in inches (mm).



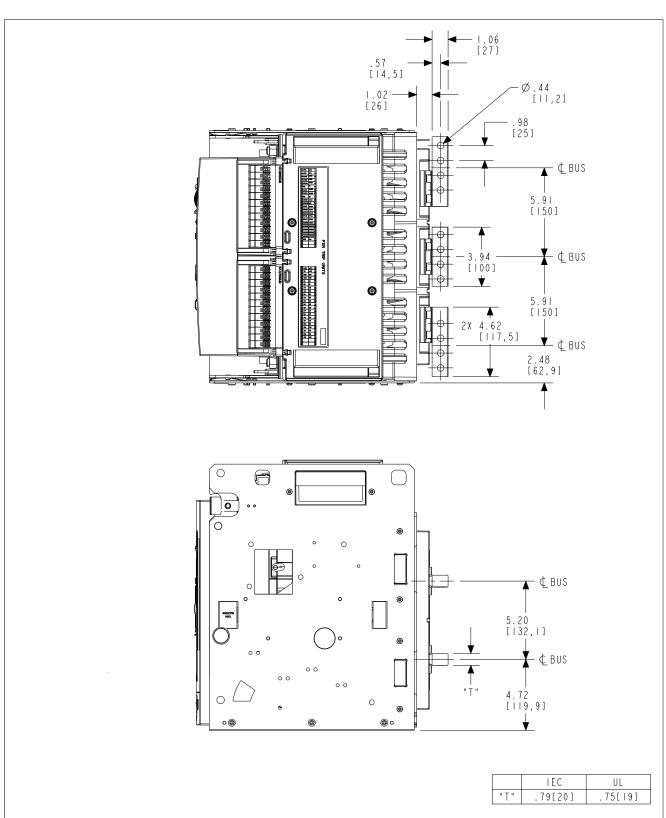


Figure 38. Three-pole drawout cassette - top/side views with offset four-hole horizontal bus adapters in inches (mm).

IEC UL 79[20] 75[19] 4.53 _ ¢_Bus 4.53 **X** ⊈ BUS 3.85 [97,9] 1.06 [27] .57 [14,5] 1.02 [26] Ø.44 [11,2] .98 [25] 0 **— ⊈** BUS 7.96 [202,1] 2X 4.62 [117,5] 3.34 [84,8] **⊚** o

Figure 39. Three-pole drawout cassette - top/side views with offset four-hole vertical bus adapters in inches (mm).

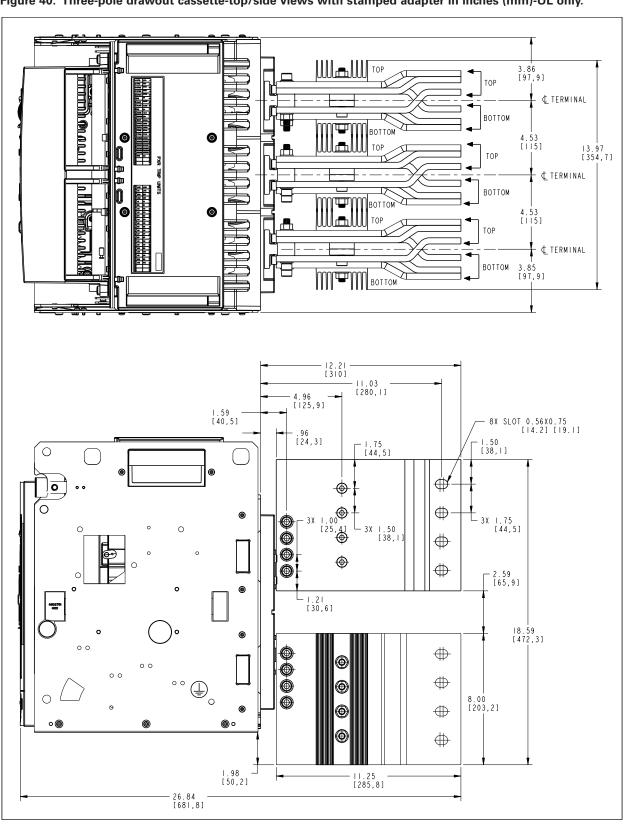


Figure 40. Three-pole drawout cassette-top/side views with stamped adapter in inches (mm)-UL only.

0 0 24.87 [631,8] - 10.24 -[260] 9.74 -[247,3] 6,24 -[158,4] **@** - 8X Ø .44 [11,2] - 3.61 -[91,7] [17,8] 0 Ť_{6X | .00} \bigoplus 4.00 9.00 14.00 [10],6] [228,6] [355,6] \bigoplus 0 0 00 00 \bigoplus [i8,1] 0 🚳 **⊗** o

Figure 41. Three-pole drawout cassette-top/side views with casted adapter in inches (mm)-UL only.

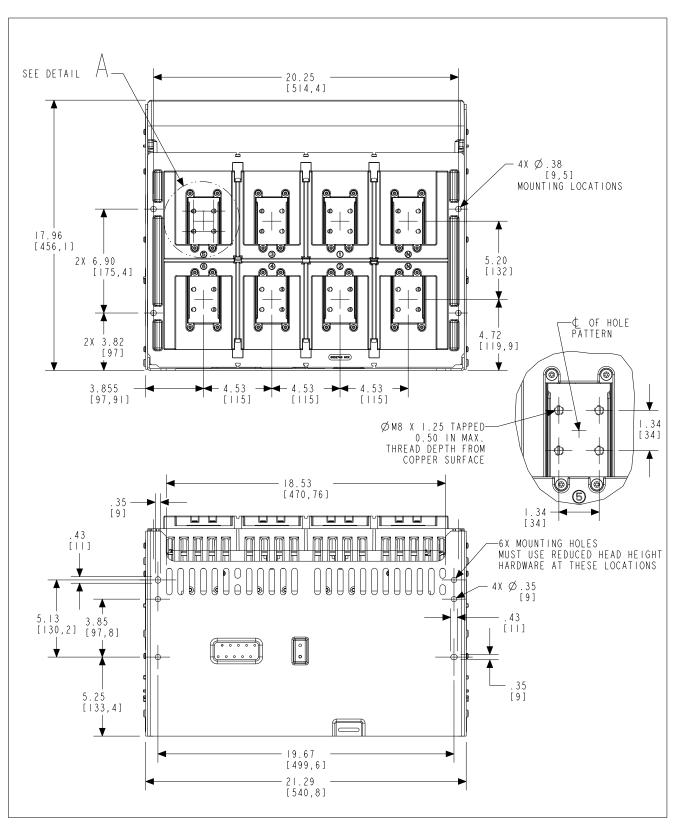


Figure 42. Four-pole drawout cassette - rear/bottom views in inches (mm).

|3.62 [345,9] .73 [18,4] . | 6 [4, |] 85.0° TRAVEL (30° FREE TRAVEL) 14.93 [379,2] 13.24 [336,3] 7.24 [183,9] .36 [9,1] .86 [21,9] 1.00 [25,4] | 4.48 [367,8] CONNECTED POSITION .58 [|4,8] 2.I7 [55,I] TEST POSITION

Figure 43. Four-pole drawout cassette - side views CONNECTED and TEST positions in inches (mm).

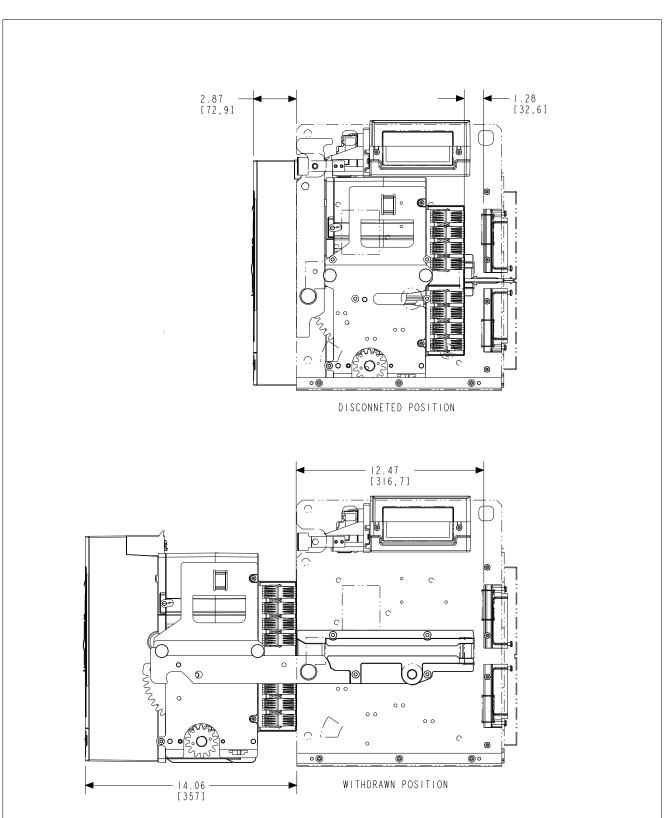


Figure 44. Four-pole drawout cassette - side views DISCONNECTED and WITHDRAWN positions in inches (mm).

(mm). 1.06 [27] .57 [14,5] |.02 [25,99] ⊈ BUS 4.53 ⊈ BUS 0 0 0 靬 🐫 BUS 0 4.53 [115] 0 0 靬 🐛 BUS 0 3.85 [97,9] 4X 2.99 [76] 0 ⊈ BUS 5.20 [132,1] ⊈ BUS 4.72 [119,9] 0 IEC UL 79[20] 75[19]

Figure 45. Four-pole drawout cassette - top/side views with centered three-hole horizontal bus adapters in inches (mm).

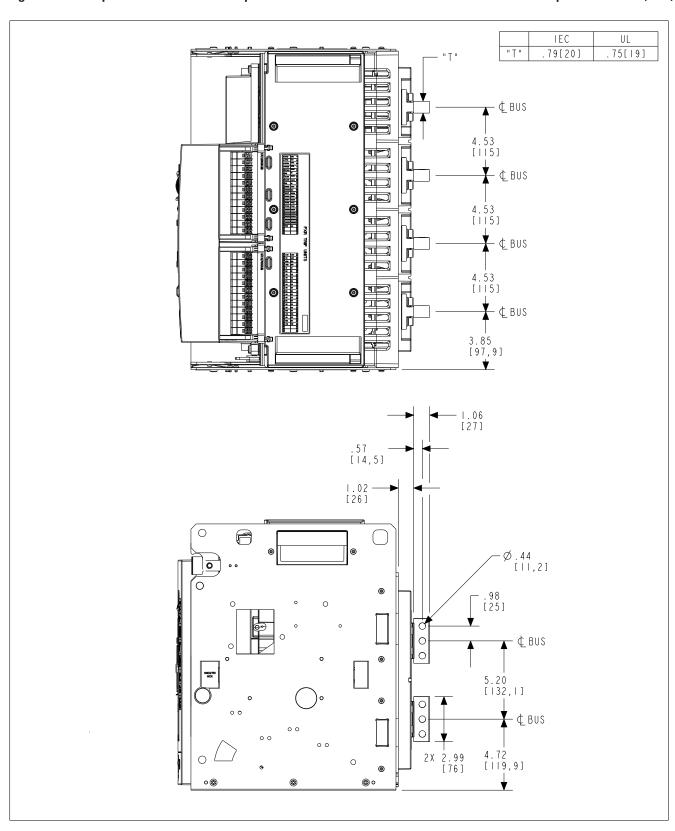


Figure 46. Four-pole drawout cassette-top/side views with centered three-hole vertical bus adapters in inches (mm).

IEC - I.06 [27] 79[20] 75[19] .57 [14,5] Ø.44 [11,2] 1.02 [26] 0 - ⊈BUS 0 .98 [25] 0 5.91 [150] ¥ ⊈BUS 21.85 [555] 2X 3.94 [100] | | . 02 | 280 | 0 5.91 [150] ¥ ¢ BUS 0 5.91 [150] 0 [45,4] 0 0 5.41 [137,5] .2⁷9 [7,1] -ISOLATION BARRIER REQUIRED FOR UL APPLICATIONS (OPTIONAL FOR IEC) **★ ¢** BUS 5.20 [132,1] 9.40 [238,8] ¥ ⊈ BUS 4.72 [119,9] **@** o 2.62 [66,5] 4.85

Figure 47. Four-pole drawout cassette- top/side views with offset four-hole horizontal bus adapters in inches (mm).

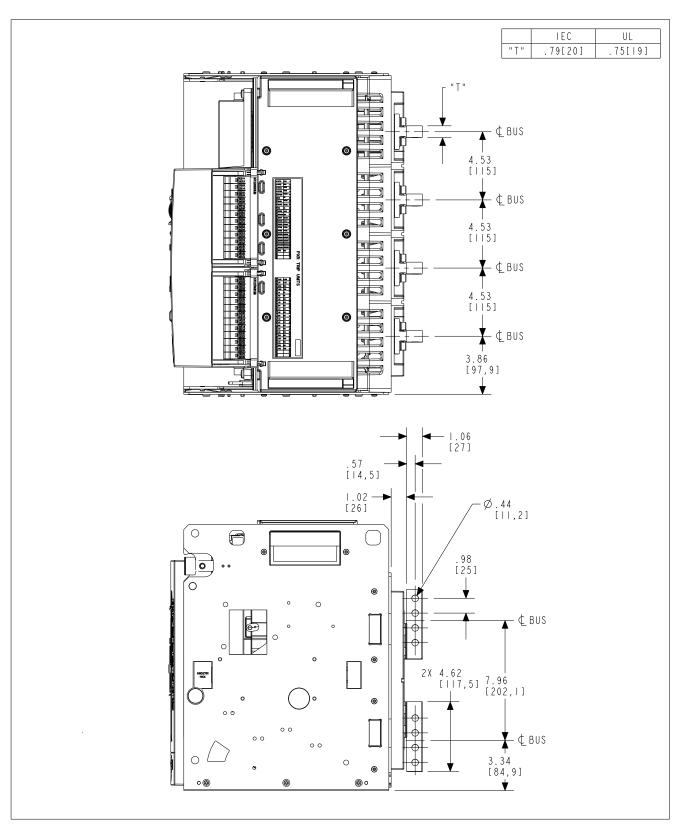


Figure 48. Four-pole drawout cassette - top/side views with offset four-hole vertical bus adapters in inches (mm).

3.86 [97,9] ₡ TERMINAL ВОТТОМ 4.53 [115] ¢_TERMINAL ВОТТОМ 18.43 [468,2] ТОР ↓ TERMINAL BOTTOM BOTTOM TOP 4.53 ВОТТОМ 3.85 [97,9] 12.21 [310] · ||.03 [280,|] 4.96 [125,9] - 1.59 _ [40,5] -8x SLOT 0.56X0.75 [14.2] [19.1] .96 [24,3] 1.75 [44,5] -1.50 [38,1] \bigoplus Ф C_{3X 1.50} 1.75 [44,5] **\$** \oplus \oplus 2.59 [65,9] 1.21 [30,6] 18.59 [472,3] \oplus 8.00 [203,2] 1.98 [50,2]

Figure 49. Four-pole drawout cassette-top/side views with stamped adapter in inches (mm)-UL only.

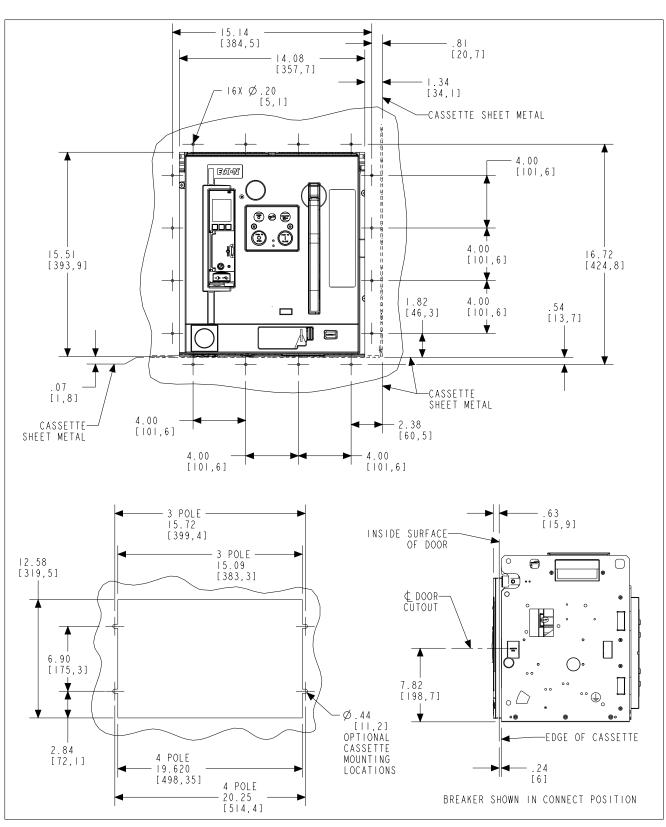


Figure 50. Three-pole/four-pole drawout cassette - front door cutout details in inches (mm).

Section 6: Dimensional drawings for installation of fixed circuit breakers

General

Section 3 discussed topics and features common to all Series NRX circuit breakers, no matter what the mounting configuration or type. In this section, features unique to the fixed configuration not covered elsewhere are discussed.

Fixed circuit breaker

A fixed circuit breaker (Figure 3) is solidly mounted in its structure with no drawout feature. The rear-connected breaker can be mounted on a suitable horizontal mounting surface using left and right-side mounting feet. A standard rear-connected fixed circuit breaker is supplied with flat primary terminal pads on the rear of the breaker that will accommodate a variety of primary connection configurations. **Optional primary adapters are available for front and rear bus connections.** For specific details and mounting instructions, refer to IL01301053E. There are special adapters designed for NRX RF 4000A UL489. Refer to IL0131147EN and IL0131150EN

Refer to Figure 51 through Figure 66 for selected mounting and installation dimensional information. Complete dimensional and installation drawings are available from www.eaton.com/seriesnrx.

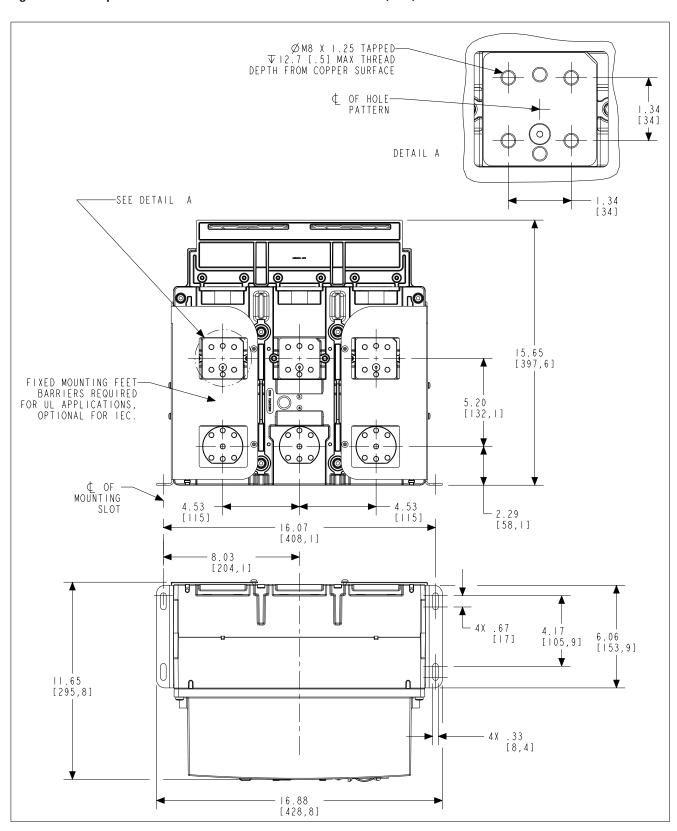
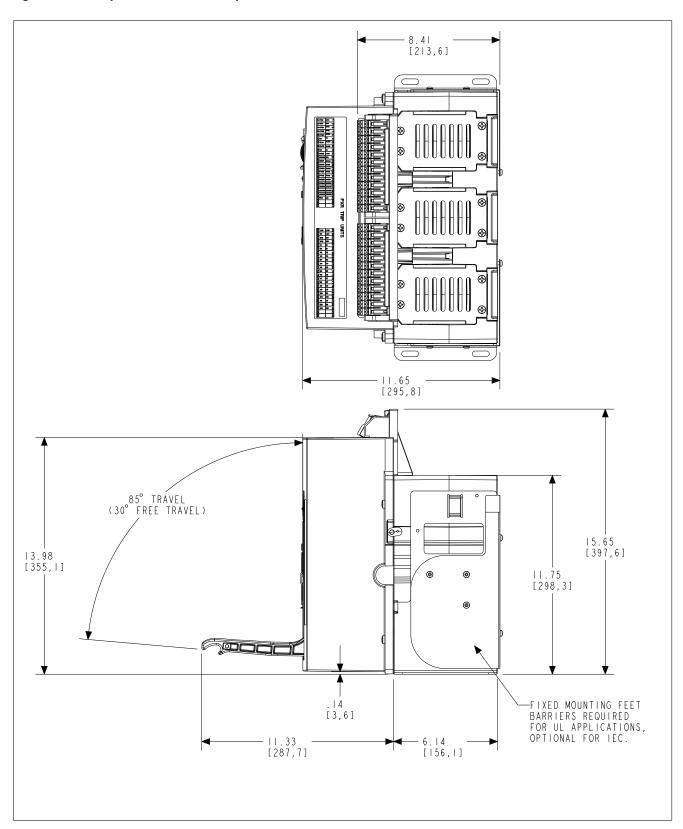


Figure 51. Three-pole fixed breaker - rear/bottom views in inches (mm).

Figure 52. Three-pole fixed breaker - top/side views in inches (mm).



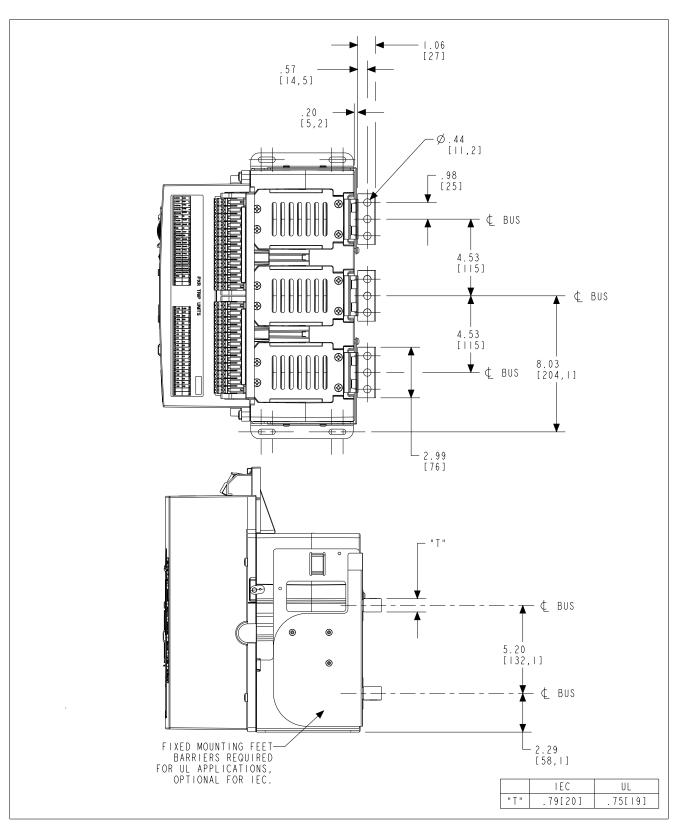
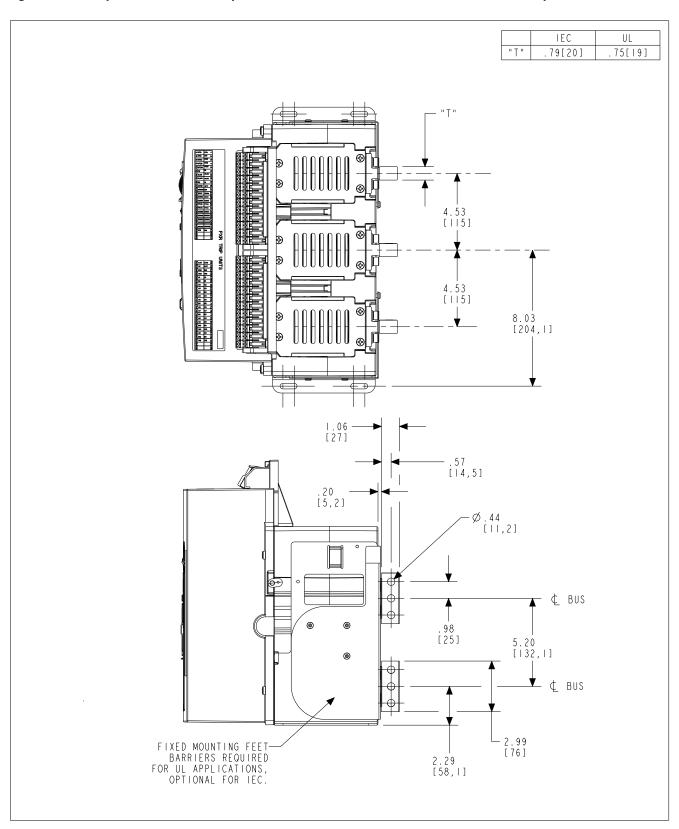


Figure 53. Three-pole fixed breaker - top/side views with centered three-hole horizontal bus adapter in inches (mm).

Figure 54. Three-pole fixed breaker - top/side views with centered three-hole vertical bus adapter in inches (mm).



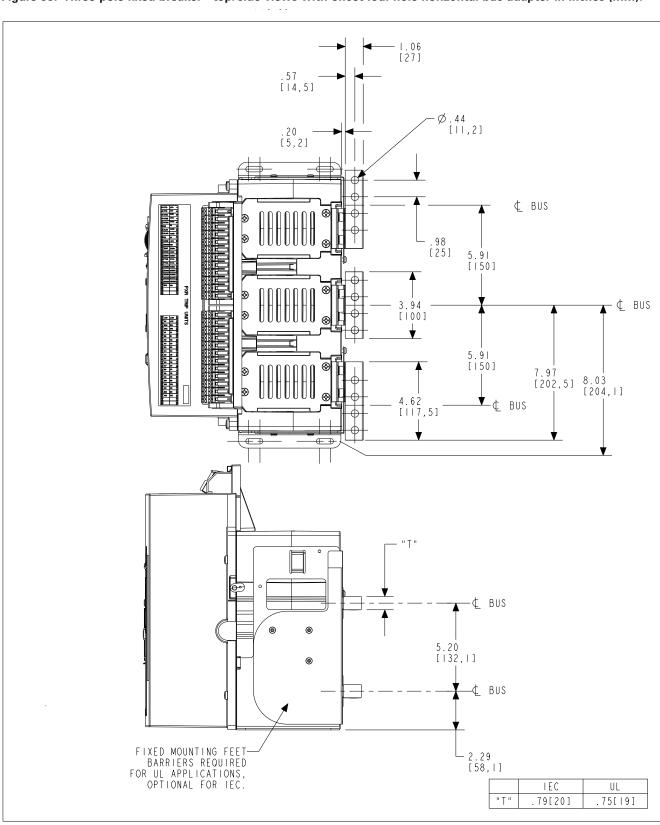
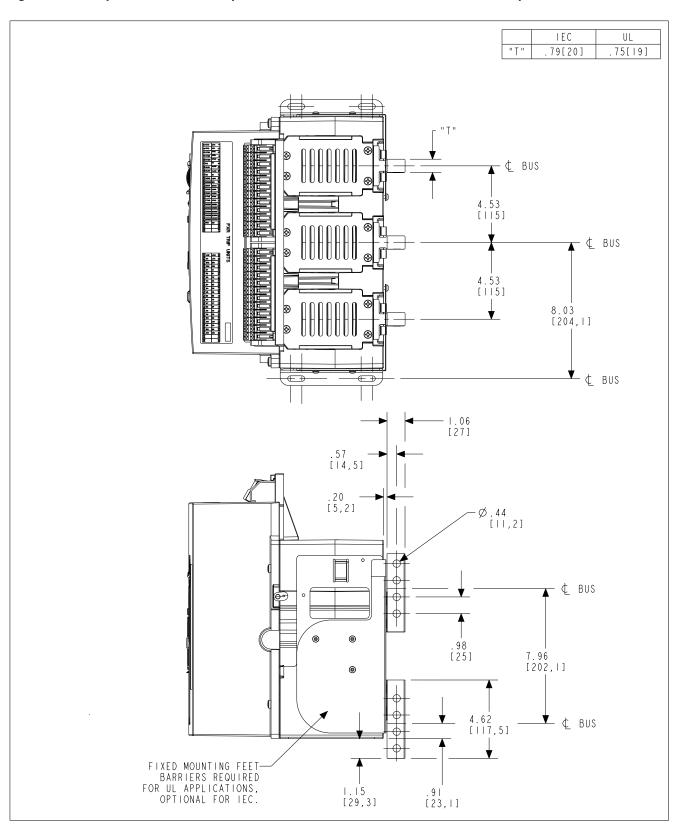


Figure 55. Three-pole fixed breaker - top/side views with offset four-hole horizontal bus adapter in inches (mm).

Figure 56. Three-pole fixed breaker - top/side views with offset four-hole vertical bus adapter in inches (mm).



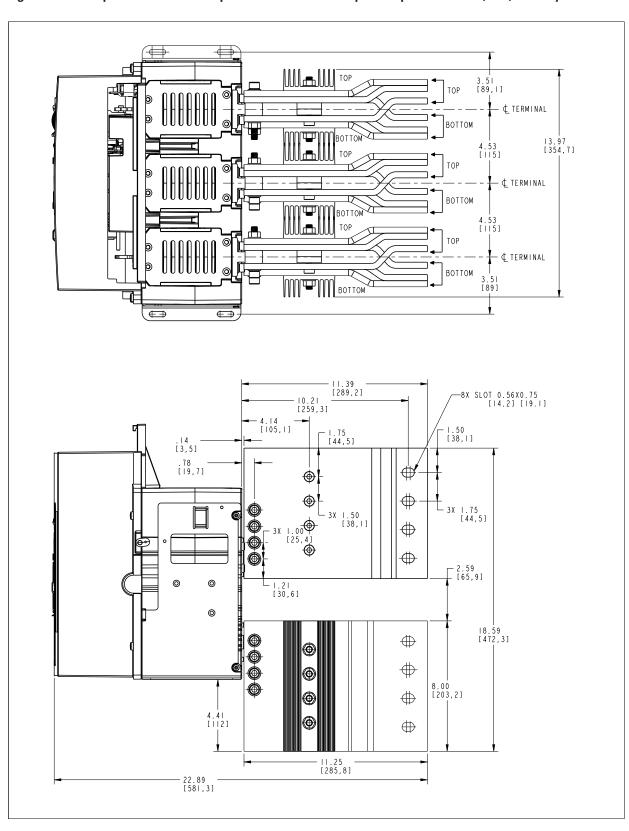


Figure 57. Three-pole fixed breaker-top/side views with stamped adapter in inches (mm)-UL only.

اللحاللا 3.51 [89,1] ¢_TERMINAL 4.53 [115] 20.31 [515,8] BOTTOM 4.53 - ¢ TERMINAL 3.51 [89] 18.92 [480,5] - 7.42 [188,4] 6.92 [175,7] - 4.57 [||6] 2.50 · [63,5] - .70 [17,8] 5.00 [127] - 3X |.00 [25,4] 0 7.50 [190,5] 2.50 [63,5] 12.50 [317,5] [40,6] 0

Figure 58. Three-pole fixed breaker-top/side views with casted adapter in inches (mm)-UL only.

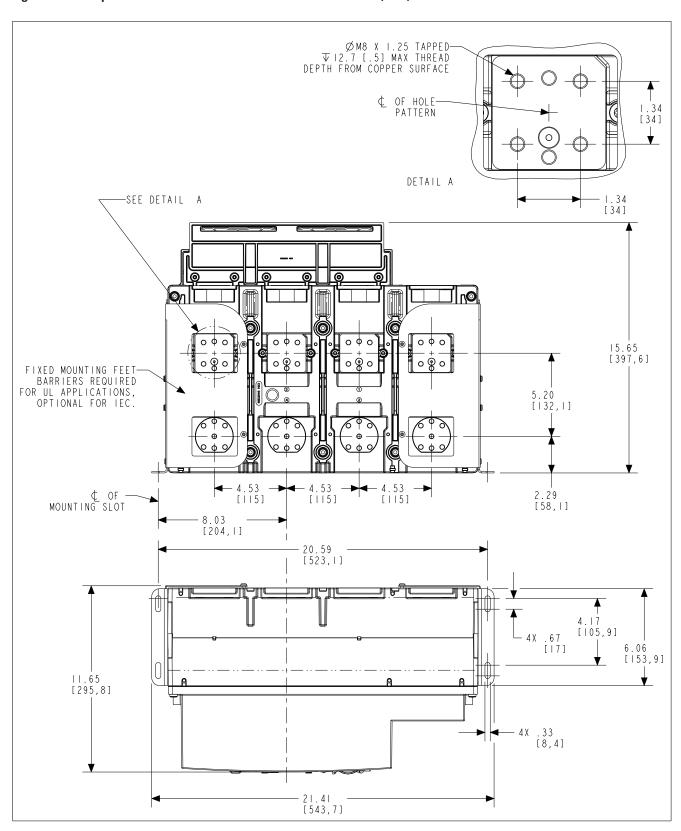
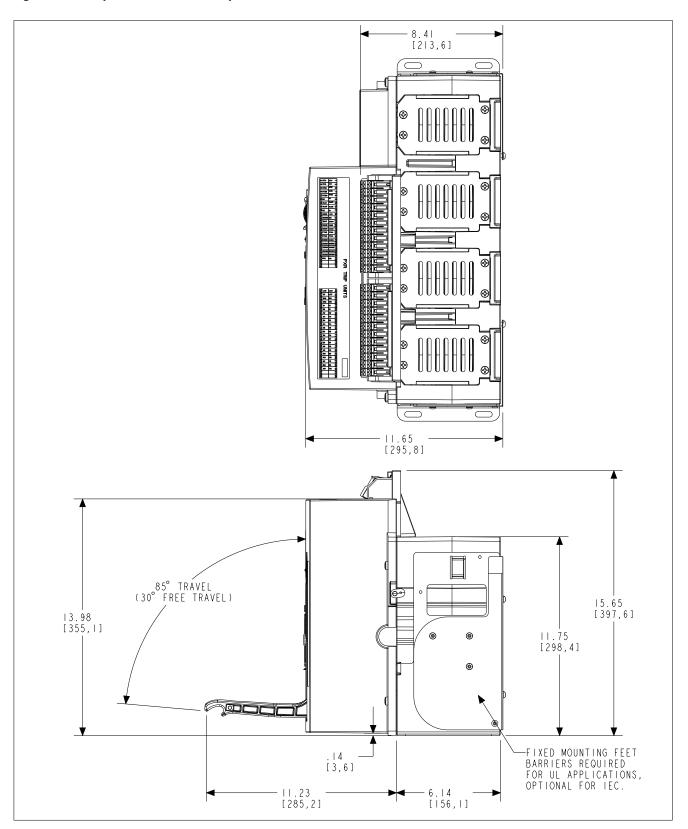


Figure 59. Four-pole fixed breaker - rear/bottom views in inches (mm).

Figure 60. Four-pole fixed breaker - top/side views in inches (mm).



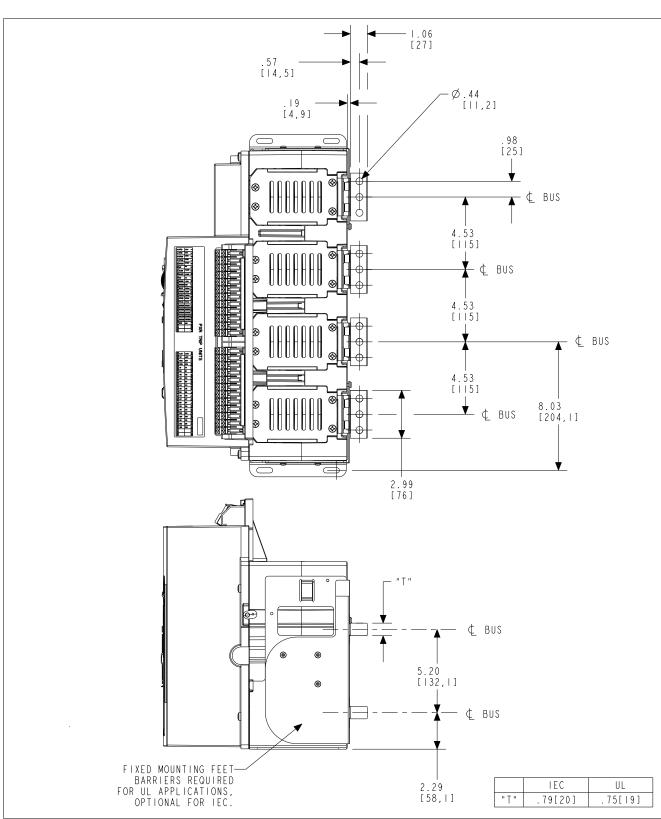


Figure 61. Four-pole fixed breaker - top/side views with centered three-hole horizontal bus adapter in inches (mm).

IEC UL 79[20] 75[19] ₡ BUS 4.53 [115] ¥ ⊈ BUS 4.53 ⊈ BUS 4.53 [115] 8.03 [204,1] ▼ ¢ BUS I.06 [27] .57 [14,5] .20 [5,2] .44 [||,2] .98 [25] ↓ BUS 5.20 [132,1] **▼** ⊈ BUS 2.99 [76] FIXED MOUNTING FEET-BARRIERS REQUIRED FOR UL APPLICATIONS, OPTIONAL FOR IEC. 2.29 [58,1]

Figure 62. Four-pole fixed breaker - top/side views with centered three-hole vertical bus adapter in inches (mm).

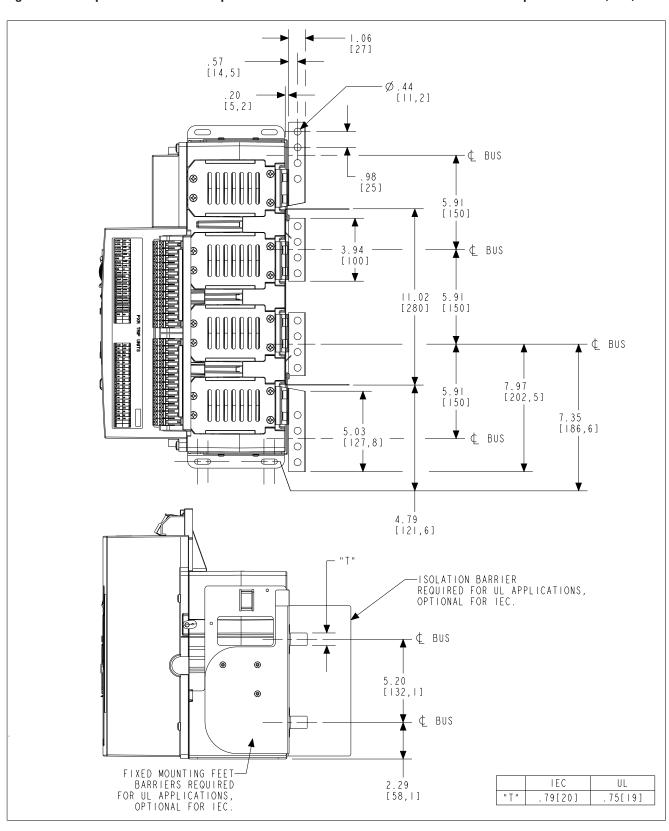


Figure 63. Four-pole fixed breaker - top/side views with offset four-hole horizontal bus adapter in inches (mm).

IEC 79[20] 75[19] -¢_ BUS 4.53 ¥ ⊈ BUS 4.53 [115] ↓ BUS 4.53 [115] 8.03 [204,|] ¥ ⊈ BUS 1.06 [27] .57 [14,5] .20 [5,2] Ø.44 [11,2] **★** ⊈ BUS .98 [25] 0 (8) 7.96 [202,1] 4.62 [117,5] **▼** ⊈ BUS 0 0 FIXED MOUNTING FEET-BARRIERS REQUIRED FOR UL APPLICATIONS, OPTIONAL FOR IEC. .91 [23,1] 1.15 [29,3]

Figure 64. Four-pole fixed breaker - top/side views with offset four-hole vertical bus adapter in inches (mm).

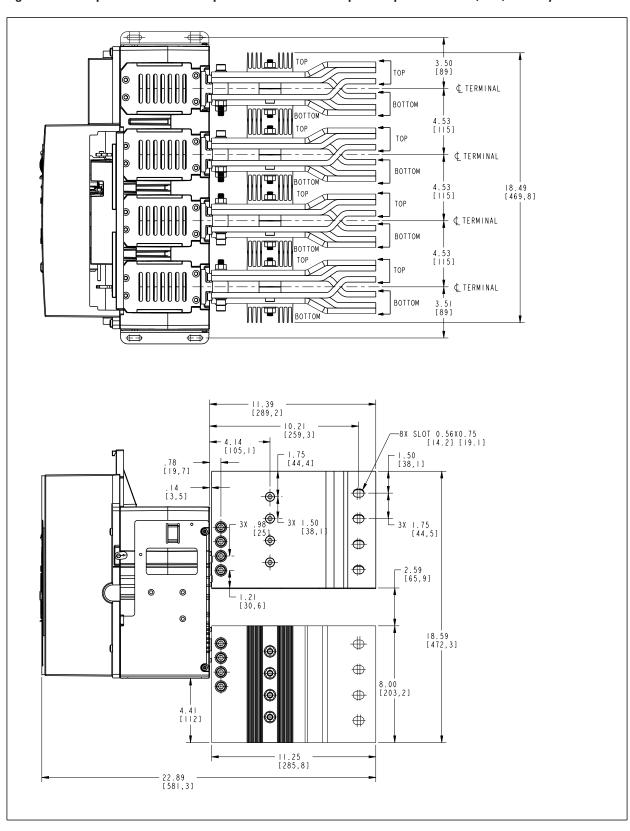


Figure 65. Four pole fixed breaker-top/side views with stamped adapter in inches (mm)-UL only.

|4.08 [357,7] .43 EDGE OF-FRONT COVER |6X Ø.20 |5,|] 4.00 FAW. 4.00 15.56 [395,2] 14.47 [367,5] EDGE OF-FRONT COVER 4.00 1.23 [31,4] [iŏĭ,6] - .53 [13,4] 4.00 .19 [4,9] 4.00 [|0|,6] 4.00 [|0|,6] 1.04 [26,4] |5.|4 [384,5] .63 [15,9] INSIDE SURFACE-OF DOOR ♠ DOOR CUTOUT-7.06 [179,4] **←** 5.38 [136,6] -MOUNTING FOOT FRONT SLOT MOUNTING SURFACE

Figure 66. Three-pole/four-pole fixed breaker - front door cutout details in inches (mm).

Section 7: Inspection and maintenance

General



WARNING

Failure to inspect, clean, and maintain circuit breakers can reduce equipment life or cause the equipment to not operate properly under fault conditions. This could result in equipment damage, bodily injury, or even death.



WARNING

The circuit breaker mechanism contains stored mechanical energy and moving parts and should be operated with the front cover and arc chutes in place. Parts may move forcefully and without warning. If the front cover or arc chutes have been removed, limit contact to the handle and buttons. Failure to do so may result in serious bodily injury.



CAUTION

Inspection and maintenance procedures should be carried out only by personnel familiar with the hazards associated with working on power circuit breakers. Additionally, they should become familiar with the specifics associated with series NRX circuit breakers as presented in this manual.

Because of the variability of application conditions and the great dependence placed upon these circuit breakers for protection and the assurance of service continuity, inspection and maintenance activities should take place on a regularly scheduled basis. Since maintenance of these circuit breakers consists mainly of keeping them clean, the frequency of scheduled inspection and maintenance depends to some degree on the cleanliness and humidity of the surroundings. It is recommended that maintenance record sheets be completed for the equipment.

General recommendations

Circuit breaker cleaning activities should be a part of an overall activity that includes the assembly in which the circuit breaker is installed. Loose dust and dirt can be removed from external surfaces using an industrial quality vacuum cleaner and/or lint-free cloth. Unless otherwise indicated, never use high pressure blowing air, since dirt or foreign objects can be driven into areas, such as the breaker mechanism, where additional friction sources could create problems. Never use a wire brush to clean any part of the circuit breaker.

When to inspect

Industry standards for this type of equipment recommend a general inspection and lubrication after the number of operations listed in Table 6. This should also be conducted at the end of the first six months of service, if the number of operations has not been reached.

Table 6. Inspection frequency.

Breaker frame size	Interval (cycles)
800 A and below	1750
Between 800 and 4000 A	500

¹ Cycle = 1 open/close operation.

After the first inspection, inspect at least once a year. If these recommended inspections show no maintenance requirements, the period may be extended to a more economical point. Conversely, if the recommended inspection shows, for instance, a heavy accumulation of dirt or other foreign matter or other electrical damage, the inspection and maintenance interval should be decreased.

What to inspect



IMPORTANT

Before doing any work, make sure a drawout breaker is levered out to the TEST, DISCONNECT, or WITHDRAWN position. During the levering out and levering in of the circuit breaker, be aware of any signs that would indicate that the levering process is not working properly. If working on a fixed circuit breaker, bus systems should be de-energized for convenience and safety. All circuit breakers should be switched to the OFF position and the mechanism springs discharged.


Once the circuit breaker has been cleaned as described previously under the topic entitled "General recommendations," visually inspect it for any signs of damage, missing or loose parts, and unusual wear. Be especially alert for foreign matter that must be removed. On drawout circuit breakers, inspect the primary disconnect finger clusters for signs of wear and erosion (Figure 2). Make appropriate corrections to anything found out of order.

Functional field testing

Eaton recommends that the following three functional tests be performed on series NRX circuit breakers as part of any maintenance procedure. Circuit breakers should be removed from service and Eaton notified if the circuit breaker fails to perform any of these tests successfully. Provide the number of operations the breaker has performed to date as well as the following nameplate information (Figure 61).

- 1. G.O. #: It: Seq:
- 2. Cust. P.O.:
- 3. Date code
- 4. Cat#:

Figure 67. Typical nameplate information.

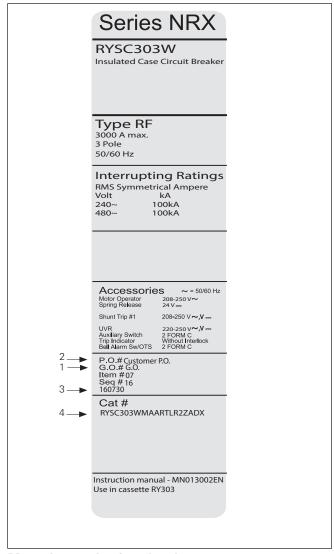

Manual operation functional test

Perform the following seven steps and verify if the circuit breaker is appropriately opened or closed as indicated by the indicator flags on the front of the breaker (Figure 4).

- Step 1: Charge the mechanism springs using charging handle or motor operator.
- Step 2: Press the ON pushbutton to close breaker manually.
- Step 3: Charge the mechanism springs using either the charging handle or motor operator. (If using motor operator, disconnect the power to motor to prevent automatic recharging).
- Step 4: Press the OFF pushbutton to manually open the breaker.
- Step 5: Press the ON pushbutton to manually close the breaker.

- Step 6: Press the OFF pushbutton to manually open the breaker.
- Step 7: Repeat the first six steps three times.

Electrical operation functional test

This test procedure is based on the assumption that the circuit breaker is equipped with both a shunt trip and spring release. If one of the accessories is missing, use the manual button to replace the accessory's function. Perform the following seven steps and verify if the circuit breaker is appropriately opened or closed as indicated by the indicator flags on the front of the breaker (Figure 4).

- Step 1: Charge the mechanism springs using the charging handle or motor operator.
- Step 2: Close the breaker by applying the rated voltage to the spring release accessory.
- Step 3: Charge the mechanism springs using either the charging handle or motor operator. (If using motor operator, disconnect power to motor prevent automatic recharging.)
- Step 4: Open the breaker by applying the rated voltage to shunt trip accessory.
- Step 5: Close the breaker using the spring release accessory.
- Step 6: Open the breaker using the shunt trip accessory.
- Step 7: Repeat the first six steps three times.

Trip unit test procedure

The trip unit may be tested via its front panel display interface or through the USB connection to a PC with the Power Xpert Protection Manager installed. Refer to the instruction manual for series NRX PXR 20/25 for instructions on testing via the display interface. For testing through the USB interface, refer to the quick start guide for the "Power Xpert Protection manager software".


Arc chute inspection

When a circuit breaker experiences a high level fault, or during regularly scheduled maintenance periods, the arc chutes should be inspected for any kind of damage or dirt. Be especially alert for signs of significant erosion within the arc chute.

To remove the arc chutes and inspect both the arc chutes and arc chambers, proceed with the following seven steps.


Step 1: (Drawout breakers) Locate the metal latches on each side of the breaker secondary contact assembly. Rotate the latch on one side by using a small tool to press the lower portion of the latch and release the light grey inner cradle which houses the accessory plugs. Push the inner cradle in a small amount to keep the latch disengaged (inner cradle will be angled). While holding the inner cradle in this position, rotate the second metal latch in a similar manner.

Figure 68. Step 1.

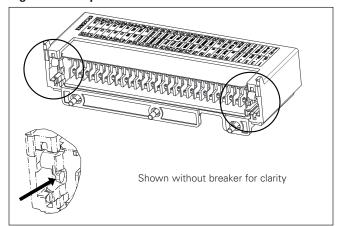


Step 2: (Drawout breakers) Once both latches are released the inner cradle can be compressed until the tool slot is visible. Insert a screwdriver vertically into the slot to hold the inner cradle in place and improve arc chute access. On the RF frame, repeat Steps 1 and 2 on the second contact assembly.

Figure 69. Step 2.

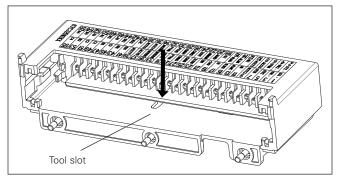


Step 3: Using a Phillips screwdriver, remove the four topinserted mounting screws from each arc chute.

Figure 70. Step 3.

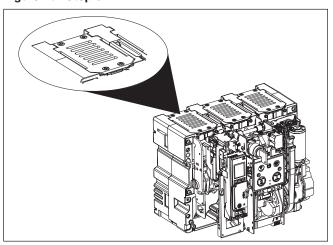

Step 4: Lift the arc chute up and out of the arc chamber.


Figure 71. Step 4.

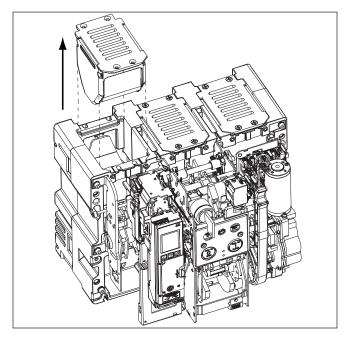

Step 5: Follow the same procedure to remove the remaining two arc chutes.

Step 6: Inspect the arc chutes for obvious damage and turn them over to inspect the inside for obvious damage or dirt accumulation. Series NRX arc chutes cannot be replaced. If damage or dirt accumulation is observed, contact Eaton for additional information.

Figure 72. Step 6.

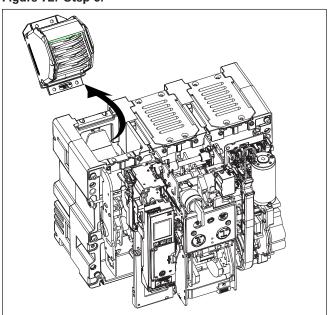

Step 7: When inspections are complete, secure arc chutes in place with their mounting screws. Remove screwdriver and verify that secondary contact assembly inner cradle relatches.



WARNING

Arc chutes and their cover plates must always be secured properly in place before a breaker is installed in its compartment. Failure to do so could result in equipment damage, bodily injury, or even death.

Primary contact inspection

With the arc chutes removed, visually inspect each primary contact structure for signs of wear and/or damage with the circuit breaker open. Series NRX primary contacts/carrier assemblies cannot be replaced. Contact Eaton for additional information.

Miscellaneous modifications and/or changes

The topics discussed here cover additional actions that relate to updating, maintaining, or repairing series NRX circuit breakers. Some actions may not be able to be accomplished in the field. In addition, this information does not include most accessory devices that are covered by separate instruction leaflets dedicated to individual devices.

Trip unit replacement

To replace a trip unit, refer to MN013003EN, instruction manual for series NRX PXR 20/25.

Current sensor replacement

The Rogowski type current sensors are not field replaceable.

Frame rating module replacement

The frame rating module is not field replaceable.

Section 8: Troubleshooting

Introduction

Table 7 will help to determine the probable causes of simple circuit breaker problems and possible corrective actions. Possible problems associated with the electronic trip unit are covered in MN013003EN. If the problem cannot be resolved with the aid of one or both of these guides, contact the Eaton service center for more in-depth assistance.

Table 7. Circuit breaker troubleshooting guide.

Symptom	Probable cause	Corrective action
The circuit breaker trips open (red fault trip indicator button is out and/or fault indicator	Repeated closing on transient (in-rush) current with thermal memory active	Wait for circuit breaker (and loads) to cool before reclosing
LED is lighted) when closed on a load current	An overload or fault current condition	Use status and fault indicators to help locate and remove overload or fault condition
Circuit breaker opens (fault trip indicator button is not out)	Undervoltage release operates; voltage too low or zero	Check and correct the UVR supply voltage (85–110% rated voltage)
	Shunt trip opens	Check control signal(s) to shunt trip; correct if necessary
	Trip latch is defective	Inspect latch condition and engagement before closing; consult Eaton
Circuit breaker cannot be opened remotely, but can be opened locally	Shunt trip control signal absent or too low	Check supply voltage exceeds 70% of rated voltage when signal is applied to shunt trip
	Shunt trip is faulty or improperly installed	Check voltage supplied to shunt trip; make sure ST is seated in its tray; check for ST motion; replace ST if faulty
	Secondary wiring problem	Make sure electrical connections are properly made and verify proper wiring
Circuit breaker cannot be opened locally	OPEN pushbutton locked	Remove lock
	Faulty mechanism or main contacts welded	Contact Eaton
Circuit breaker makes no attempt to close with either local (manual) or remote controls; springs do not discharge	Closing spring not fully charged (check SPRING CHARGED indicator)	Charge spring manually; check voltage to electrical operator; replace operator if faulty
	If equipped with undervoltage release, undervoltage release is not energized or is faulty	Remove left accessory tray containing UVR and retry closing operation; if OK, check voltage supply to UVR (>85%); replace UVR if faulty
	Circuit breaker locked in OPEN position	Check reason for lock
	Drawout position interlock is operating; levering screw	Make sure circuit breaker is at a position that permits closure; check that shutter door over levering screw is fully closed
	Circuit breaker interlocked with another circuit breaker or device	Check for presence of an interlocking scheme (cable or key); check to see if interlocked circuit breaker is CLOSED
Circuit breaker can't be closed remotely (can be closed locally)	Spring release (closing) coil supply voltage low or SR faulty	Check power supply voltage; replace spring release if faulty
	Secondary contact wiring problem	Make sure electrical connections are properly made and verify proper wiring
Circuit breaker can't be closed locally (can be closed remotely)	Opening and/or closing pushbuttons locked	Check reason for lock
Circuit breaker does not recharge electrically but will recharge manually	Charging motor supply voltage absent or too low (<85%)	Check charging motor electrical circuit voltage (under load)
	Charging motor faulty	Replace motor assembly
Drawout circuit breaker will not lever in	Cell rejection code plate	Breaker rating not compatible with cassette requirement
	Levering-in screw not fully in DISCONNECT position at insertion	Rotate levering handle counterclockwise to DISCONNECT position, then insert circuit breaker fully into cassette
	Circuit breaker not pushed into cassette far enough	Push circuit breaker in as far as possible
	Protective shutters jammed/locked	Clear problem
	Position detent is engaged	Reset detent system

Disclaimer of warranties and limitation of liability

The information, recommendations, descriptions, and safety notations in this document are based on Eaton experience and judgment, and may not cover all contingencies. If further information is required, an Eaton sales office should be consulted.

Sale of the product shown in this literature is subject to the terms and conditions outlined in appropriate Eaton selling policies or other contractual agreement between Eaton and the purchaser.

THERE ARE NO UNDERSTANDINGS, AGREEMENTS, WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR MERCHANTABILITY, OTHER THAN THOSE SPECIFICALLY SET OUT IN ANY EXISTING CONTRACT BETWEEN THE PARTIES. ANY SUCH CONTRACT STATES THE ENTIRE OBLIGATION OF EATON. THE CONTENTS OF THIS DOCUMENT SHALL NOT BECOME PART OF OR MODIFY ANY CONTRACT BETWEEN THE PARTIES.

In no event will Eaton be responsible to the purchaser or user in contract, in tort (including negligence), strict liability, or otherwise for any special, indirect, incidental, or consequential damage or loss whatsoever, including but not limited to damage or loss of use of equipment, plant or power system, cost of capital, loss of power, additional expenses in the use of existing power facilities, or claims against the purchaser or user by its customers resulting from the use of the information, recommendations, and descriptions contained herein.

The information contained in this manual is subject to change without notice.



1000 Eaton Boulevard Cleveland, OH 44122 United States Eaton.com



© 2022 Eaton All Rights Reserved Printed in USA Publication No. MN013002EN/TBG001603 Part Number: MN013002ENH03 November 2022

Eaton is a registered trademark.

All trademarks are property of their respective owners.