



Sample image

Datasheet

Article number: 70024333


Designation: CA20.A291*NLB403.PF1

Description: Switch

IEC 60947-3 EN 60947-3, VDE 0660 Teil 107						
Rated insulation voltage Ui						
Voltage (V) AC / DC						
690 AC / DC						
Rated uninterrupted current Iu/Ith						
Current (A)	Ambient temperature (°C)	Peak temperature (°C)	additional requirements			
25	55	60	Ambient temperature +55°C during 24 hours with peaks up to +60°C			
Rated operational current Ie						
Utilization category		Voltage (V)		Current (A)		
AC-15		220 - 240		8		
AC-15		380 - 440		5		
Rated operational power						
Utilization category	Voltage (V)	No. of phases	No. of poles	Power (kW)		
AC-3	220 - 240	3	3	4		
AC-3	380 - 440	3	3	7,50		
AC-3	660 - 690	3	3	7,50		
AC-3	220 - 240	1	2	3		
AC-3	380 - 440	1	2	3,70		
AC-23A	220 - 240	3	3	5,50		
AC-23A	380 - 440	3	3	11		
AC-23A	660 - 690	3	3	11		
AC-23A	220 - 240	1	2	3		
AC-23A	380 - 440	1	2	5,50		
Max Fuse Rating IEC						
Fuse characteristic		No. of Fuses		Current (A)		
gG		1		35		
UL60947-4-1 , UL508						
Nominal Voltage						
Voltage (V) AC / DC						
600 AC						
Rated insulation voltage Ui						
Voltage (V) AC / DC						
600 AC						
Rated thermal current						
Current (A)		Ambient temperature (°C) Additional Text				
30		0 - 40 --				
Horsepower rating						
Across-the-Line Motor Starting		Voltage (V)	No. of phases	No. of poles	Power (HP)	Ambient temperature [°C]
Reversing		110 - 120	1	2	0,33	40
Reversing		220 - 240	1	2	0,75	40
Reversing		277 - 277	1	2	1	40
Reversing		415 - 415	1	2	1,50	40
Reversing		440 - 480	1	2	2	40
Reversing		550 - 600	1	2	2	40
Reversing		110 - 120	3	3	1	40
Reversing		220 - 240	3	3	2	40
Reversing		415 - 415	3	3	3	40
Reversing		440 - 480	3	3	5	40
Reversing		550 - 600	3	3	5	40
DOL		110 - 120	1	2	1,50	40
DOL		220 - 240	1	2	3	40
DOL		277 - 277	1	2	3	40
DOL		415 - 415	1	2	3	40
DOL		440 - 480	1	2	5	40
DOL		550 - 600	1	2	5	40
DOL		110 - 120	3	3	3	40
DOL		220 - 240	3	3	7,50	40
DOL		415 - 415	3	3	7,50	40
DOL		440 - 480	3	3	10	40

Horsepower rating						
Across-the-Line Motor Starting		Voltage (V)	No. of phases	No. of poles	Power (HP)	Ambient temperature [°C]
DOL		550 - 600	3	3	10	40
Pilot duty rating code						
Duty Code						
A600						
SCCR / Max. fuse rating						
Conditions of acceptability						
These devices are suitable for use on circuits capable of delivering not more than 5000 rms symmetrical amperes, 600V ac max. when protected by Class RK1 fuses. Manual Motor Controllers when intended for use as a motor disconnect are suitable for use on a circuit capable of delivering not more than 5000 rms symmetrical amperes, 600V ac max. when protected by 30A Class J time delay fuses.						
Temp. rating of wire						
Temperature rating (°C)			Current (A) Text			
75			– Use copper wire only			
Connecting instructions						
Markings						
When intended for use as a motor disconnect the device shall be provided with a method of being locked in the OFF-position.						
General Use						
AC / DC	Voltage (V)	Current (A)	No. of phases	No. of poles	No. of contacts in series	
AC	600	30	1	2	1	
AC	600	30	3	3	1	
CSA						
Nominal Voltage						
		Voltage (V) AC / DC				
		600 AC				
Rated insulation voltage Ui						
		Voltage (V) AC / DC				
		600 AC				
Rated thermal current						
Current (A)			Ambient temperature (°C)		Additional Text	
30			0 - 40		–	
Horsepower rating						
Across-the-Line Motor Starting		Voltage (V)	No. of phases	No. of poles	Power (HP)	Ambient temperature [°C]
DOL		110 - 120	1	2	1,50	40
DOL		220 - 240	1	2	3	40
DOL		277 - 277	1	2	3	40
DOL		415 - 415	1	2	5	40
DOL		440 - 480	1	2	5	40
DOL		550 - 600	1	2	5	40
DOL		110 - 120	3	3	3	40
DOL		220 - 240	3	3	7,50	40
DOL		415 - 415	3	3	10	40
DOL		440 - 480	3	3	10	40
DOL		550 - 600	3	3	10	40
Pilot duty rating code						
Duty Code						
A600						
Temp. rating of wire						
Temperature rating (°C)			Current (A) Text			
75			– only			
General Use						
AC / DC	Voltage (V)	Current (A)	No. of phases	No. of poles	No. of contacts in series	
AC	600	30	1	1	1	
GENERAL TECHNICAL INFORMATION						
Tightening torque of screws						
			tightening torque (Nm)		tightening torque (lb-in)	
			1		9	
Stripping length						
			Length (mm) –			
			9 STRIPPINGLENGTH			
Size of conductor						
composition of conductor	Min. / Max. value	No. of conductor per terminal		Cross section (mm²) or (AWG/kcmil)		Material of the wire
solid wire	Min.	1		0.75mm²		Copper
solid wire	Min.	2		0.75mm²		Copper
flexible wire	Min.	1		1.5mm²		Copper
flexible wire	Max.	2		AWG 12		Copper
flexible wire	Max.	2		4mm²		Copper
flexible wire	Min.	2		1.5mm²		Copper
Single-core or stranded wire	Max.	2		AWG 10		Copper
Single-core or stranded wire	Max.	2		4mm²		Copper
flexible wire with ferrule according to DIN 46228	Min.	1		1mm²		Copper
flexible wire with ferrule according to DIN 46228	Max.	2		2.5mm²		Copper
flexible wire with ferrule according to DIN 46228	Min.	2		1mm²		Copper
Approbations						
Specification						Marking
EAC						

Approbations		Marking
Specification		
CE marking		
UK Directives		
CSA C.22.2 No.14		
GB/T14048.3		
Recommended screw driver		
Type of screw driver	Value	
Cross Screwdriver	PH1	
Slot screwdriver according to DIN 5264	0,8x5,5	
General Information		
Text		
- Do not lubricate or treat contacts. - Switches may only be mounted, connected and set into operation by qualified persons according to the accepted rules of technology. - Use copper wire only. Do not coat the wire end with tin. - Terminals with factory fitted jumper links are tightened during production. Take care during installation to ensure factory fitted links are not lost by undoing both sides of linked terminals. After wiring, all terminal screws must be tightened to recommended torque specifications. - After installation of the switches the spacings between the terminals must be sufficient to fulfill the requirement of the applicable standards.		
Waste Electrical & Electronic Equipment (WEEE)		
Picture name	Description	
	Do not throw in the trash as care must be taken to ensure environmentally sound disposal and recycling. Please either use an environmentally friendly waste disposal company; return to the supplier for disposal; or return direct to the manufacturer, Kraus & Naimer. You can find local Kraus & Naimer offices at www.krausnaimer.com	
Proposition 65		
Picture name	Description	
	WARNING: This product can expose you to chemicals including nickel and lead, which is known to the State of California to cause cancer. For more information go to www.P65Warnings.ca.gov .	
Classification Contact: Rigid contact bridge		
Classification Contact Mat: Silver		
Classification Terminal: Screw terminal		

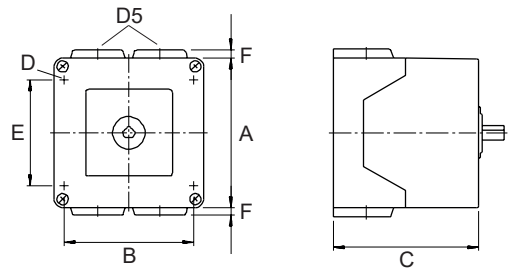Mounting-PF1			
			
IP - Code front side		IP65	
Stages		1,00 - 2,00	
A	□	82,00 mm	
B	H	68,00 mm	
C	H	64,70 mm	
D	Ø	4,40 mm	
D5	Ø	4,00 x M20	
E	H	52,00 mm	
F	H	5,00 mm	

Wiring diagram

CA20.A291.PF1



Switch program

CA20.A291.PF1



Kraus & Naimer

CA20
A291
Page 1 of 1

Face Plate													
													
		1	3	5	7	9	11	13	15	17	19	21	23
Switching Angle 90 Total switching Angle 90		2	4	6	8	10	12	14	16	18	20	22	24
0		270											
		285											
		300											
		315											
		330											
		345											
1		0											
		15											
		30											
		45											
		60											
		75											
		90											
		105											
		120											
		135											
		150											
		165											
		180											
		195											
		210											
		225											
		240											
		255											

Version: 96

Face plate

S1.F456/C10.V11H





Sample image

PADLOCK DEVICE with F-handle ring

Designation: S1.V840G/A71/C1


Colour of F-handle ring: "A" black

Colour of face ring: "7" electro-grey

Locking position: "1" at 09:00 (1x90°)

Type of mounting: "C" for type of mounting PN, PF, PFA-PFF

Switch type: "1" for C-switches and for KG10.

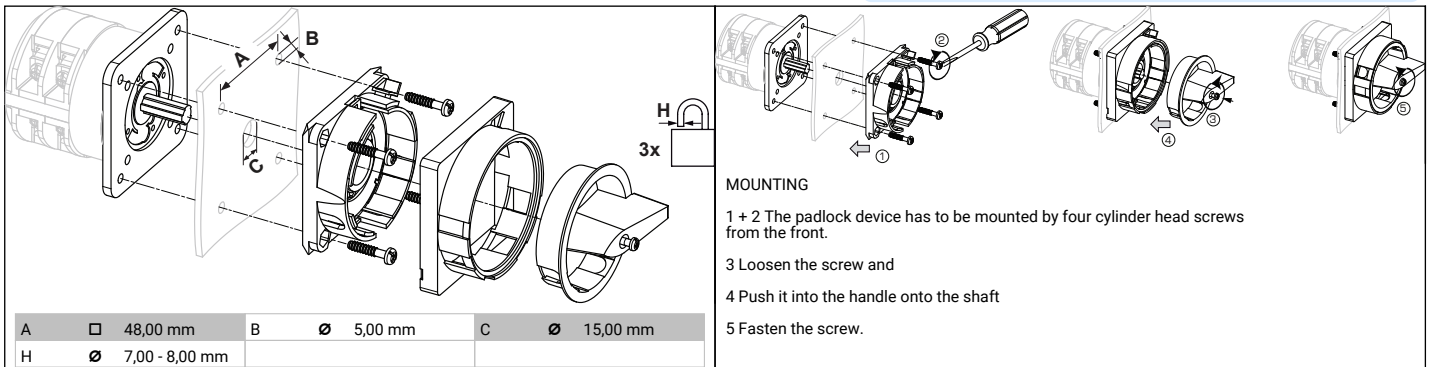


MOUNTING

1 + 2 The padlock device has to be mounted by four cylinder head screws from the front.

3 Loosen the screw and

4 Push it into the handle onto the shaft

5 Fasten the screw.

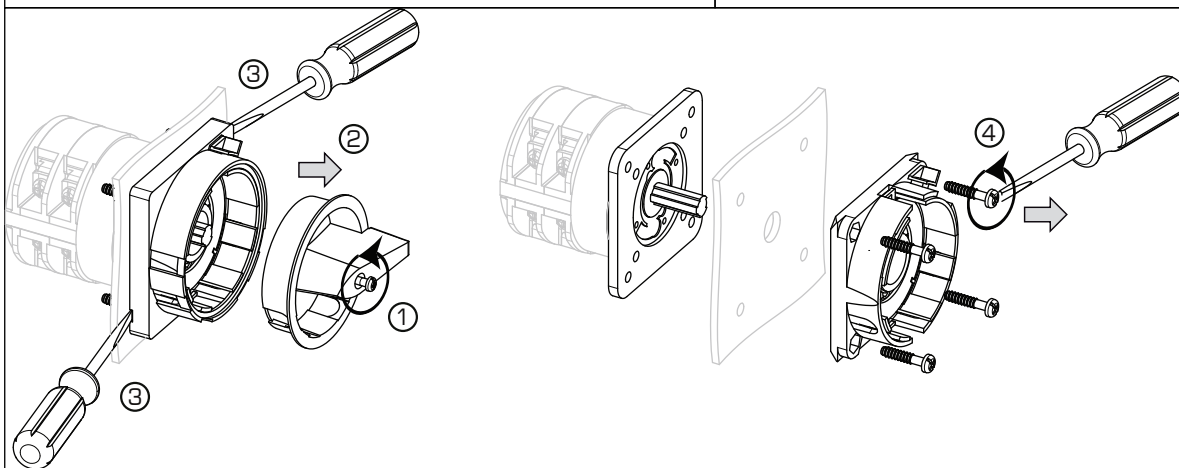

1 Loose handle screw

2 remove handle.

3 Insert a proper auxiliary tool at those points of the frame of the device which are marked by a screw driver on the drawing and remove the frame.

4 Fixing screws can be loosen now.