



Available finish:- Grey

Read these instructions before commencing installation & retain them for future reference.

IP65 240V 36W

These fittings are Class I and must be Earthed

Important Information

It is recommended that luminaires are installed and fitted by a qualified electrician ensuring the installation complies with current IEE wiring regulations & local building control. These products are designed for connection to a 240V 50Hz supply. Any broken or damaged parts should be replaced as soon as possible. KSR will not accept responsibility for any claims arising from a poor installation.

General Maintenance


General maintenance and cleaning should be performed at least quarterly. Clean product outer using a damp cloth. A non abrasive cleaner can be used for heavy deposits. After any maintenance, remember to check all seals are intact.

Installation Procedure

Familiarize yourself with the luminaire
Ensure the power is turned off before installing the luminaire.
Fix the retaining clips to the ceiling*.
Install the body on to the retaining clips*.
Unclip the diffuser to expose the LED tray.
Pinch the 2 grey tabs to release the LED tray from the body.
Retaining straps are installed to prevent the LED tray from falling during install.
Connect the mains wiring as per the guide below, Brown (LSW) Switch Live, Black (LPERM) Permanent Live, Blue (N) Neutral and Green/Yellow (G/Y) Earth.
Connect Battery.
Re-install the LED tray by pushing onto the grey tabs making sure it locks back into place.
Tighten the cable gland.
Turn on the power and test the luminaire.

*This product is suitable for suspending using the supplied metal suspension kit that hooks either side of the fixing bracket as per Fig.1

LEDs are an inductive load so avoid unwanted MCB tripping it may be necessary to uprate your breakers.

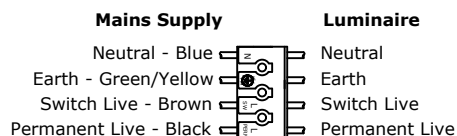

KSR Lighting Ltd, Unit E Hazleton Interchange, Lakesmere Road, Horndean, Hampshire, PO8 9JU


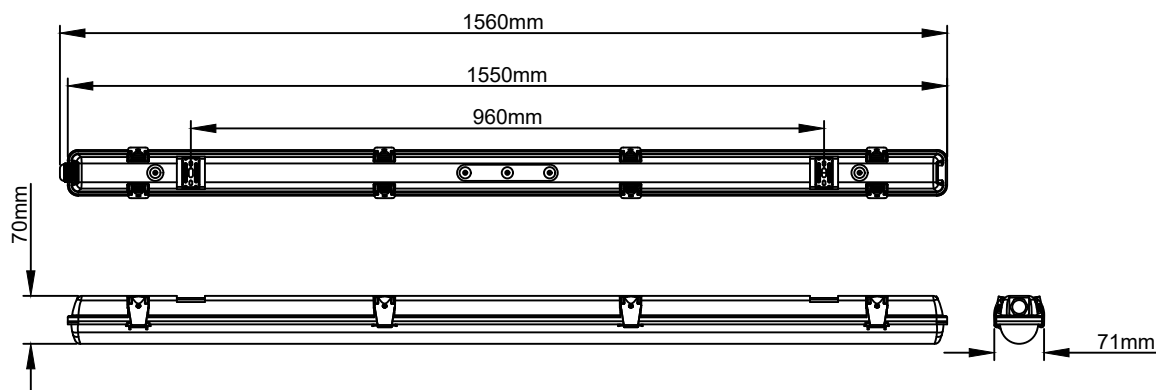


Fig.1



Lamp Details

Wattage: 36W Integral LED Module
Colour: 4000K
Lumens: 4382
CRI: >80Ra
Dimmable: No
Replaceable Module: No
Cable: 6-10mm

KSR Lighting Aftersales: 023 92 674343
E-mail: aftersales@ksrlighting.com

Emergency Lighting Periodic Test Schedule

All emergency lighting should be installed and tested in accordance to EN5266-1:2011. This test schedule should remain onsite and be accessible to the relevant authorities on request.

[illegible]

Site Address: _____

Test Conducted By: _____

Date of Test Completion:

Comments/Actions

This image shows a blank sheet of white paper with horizontal ruling lines. The lines are evenly spaced and extend across the width of the page. There are no margins, text, or other markings on the paper.

x √=Pass, X=Fail, N/T=Not Tested, N/A=No Access, U/T=Uncomplete Test