


MicroRex analogue time switches

for rail

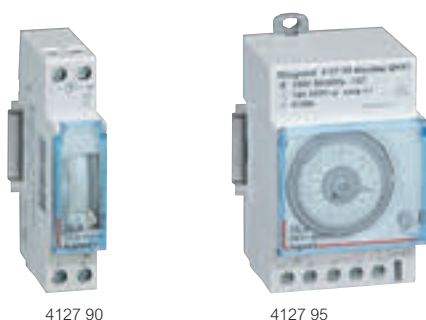

4127 90

4127 95

Conform to EN 60730-1 and EN 60730-2-7
Programmed via captive segment
Supply voltage : 230 V~ 50/60 Hz
1 x 16 A output
Manual changeover to summer/winter time
Mount on DIN rail EN 60715

Pack	Cat. Nos.	Daily programme
1	4127 80	24 hour programme One segment : 15 minutes Switching accuracy : ± 5 minutes T11 Daily 1 channel Without working reserve N/O contact Minimum switching time : 15 minutes Vertical dial
1	4127 90	QT11 Daily 1 channel With 100 hr working reserve N/O contact Minimum switching time : 15 minutes Vertical dial
1	4128 12	T31 Daily 1 channel Without working reserve Changeover switch Minimum switching time : 30 minutes Horizontal dial
1	4128 13	QT31 Daily 1 channel With 100 hr working reserve Changeover switch Minimum switching time : 30 minutes Horizontal dial

No. of
17.5 mm
modules
1

1

Pack	Cat. Nos.	Weekly programme
1	4127 94	7 day programme One segment : 2 hours Switching accuracy : ± 30 minutes QW11 Weekly With 100 hr working reserve N/O contact Minimum switching time : 2 hours Vertical dial
1	4127 95	QW31 Weekly With 100 hr working reserve Changeover switch Minimum switching time : 4 hours Horizontal dial

No. of
17.5 mm
modules
1

3


Technical information

Cat. Nos.	Programme	Segment	Min. switching time	Working reserve	16 A output via contact		No. of modules
					N/O	Chang. S.	
4128 12	24 h	15 min	30 min	without	—	1	3
4128 13	24 h	15 min	30 min	100 h	—	1	3
4127 80	24 h	15 min	15 min	without	1	—	1
4127 90	24 h	15 min	15 min	100 h	1	—	1
4127 94	7 d	2 h	2 h	100 h	1	—	1
4127 95	7 d	2 h	4 h	100 h	—	1	3

Wiring diagrams

Cat. Nos. 4127 80/90/94

Cat. Nos. 4128 12/13/4127 95

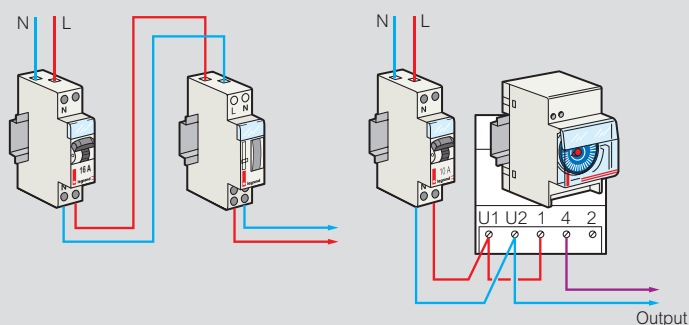

Output closing and breaking times are calculated based on the date, the actual time when the device was switched and on geographical coordinates of the actual location

Dimensions (mm)

Cat. Nos. 4127 80/90/94

Cat. Nos. 4128 12/13/4127 95

