# CIRCUIT PROTECTION REQUIREMENTS WITHIN ELECTRICAL INSTALLATIONS.

#### SOCKET CIRCUITS 411.3.3

RCDs are required to provide additional protection. To be recognised as providing additional protection the RCD must be rated at 30mA or less and operate within 40ms when tested at 5x rated residual operating current (415.1).

- RCDs are required for all socket outlets
- rated up to 20A. Two exceptions are allowed for;
- 1. Where, for other than an installation in a dwelling, a documented risk assessment determines that the RCD protection is not necessary.
- 2. A socket outlet suitably identified for connection of a particular item of equipment (not general use).

Additional protection must be provided in the event of failure of the provision of basic protection and/or the provision of fault protection or carelessness by users of the installation. Protection by 30mA RCD will be required for;

- Upstairs ring circuit Kitchen ring circuit
- Downstairs ring circuit
- Cooker control unit c/w socket outlet

# **CONCEALED CABLES**

# Cables installed in a wall or partition (1)

A cable concealed in a wall or partition at less than 50mm from the surface shall:

- 1. Be installed in the prescribed zones or

Where 1. but not 2. applies the cable shall be provided with additional protection by RCD having the characteristics described by 415.1.1

# Cables installed in a wall or partition (2)

Irrespective of depth a cable concealed in a wall or partition having a construction which includes metallic parts shall;

- 1. Be provided with additional protection by RCD having the characteristics described by 415.1.1 or
- 2. Be mechanically protected to avoid damage during construction of the wall or partition and during installation of the cable or
- 3. Comply with

For a cable installed at a depth of less than 50mm the requirements of 1 & 2 shall also apply.

# Non RCD protected cable methods

For non RCD protected circuit a cable shall;

- 1. Incorporate an earthed metallic covering suitable for service as the CPC or
- 2. Be enclosed in earthed conduit or
- 3. Be enclosed in earthed trunking or ducting
- 4. Be protected against damage from penetration by nails or screws and the like or
- 5. Form part of a SELV or PELV circuit.

In the majority of domestic situations cables installed beneath a plaster surface within partition walls without mechanical protection will require additional protection by 30mA RCD regardless of their routing.

- Upstairs lighting
- Downstairs lighting
- Immersion heater
- Smoke alarm
- Burglar alarm

# Bathrooms

- Section 7 Special installations or Locations.
- Section 701 Locations containing a bath or shower.

# Regulation 701.411.3.3

Additional protection shall be provided for all low voltage circuits either serving the location or passing through zones 1 or 2 of the location by the use of one or more RCDs having the characteristics described by 415.1.1.

• Supplementary bonding is not required as long as final circuits of this location comply with requirements for automatic disconnection (411.3.2) and all extraneous conductive parts are effectively connected to the protective equipotential bonding (411.3.1.2).

Additional protection must be provided by one or more 30mA RCDs.

- shower circuit
- lighting circuit
- Heating circuit
- Ventilation circuit
- Any circuit passing through

# Chapter 31

314.1 Requires that; Every installation shall be divided into circuits, as necessary, to:

i. Avoid danger and minimise inconvenience in the event of a fault ii. Facilitate safe inspection, testing and maintenance

iii. Take account of danger that may arise from the failure of a single circuit such as a lighting circuit

iv. Reduce the possibility of unwanted tripping of residual current devices (RCDs) due to excessive protective conductor currents produced by equipment in normal operation.


# MAINS SUPPLIES FOR SMOKE ALARMS WITHIN DOMESTIC SETTINGS

Clause 7.1 of BS 5839-6 defines a Grade D system as: "A system of one or more mains-powered smoke alarms, each with an integral standby supply (The system may in addition, incorporate one or more mains-powered heat alarms each with an integral standby supply).

The 17th Edition of the wiring regulations do not cover every item of Electrical Equipment likely to be installed. They do not specifically mention Smoke Alarms. However:

CHAPTER 13 REGULATION 134.1.1 states that electrical equipment shall be installed in accordance with the instructions of the manufacturer of the equipment

CHAPTER 51 REGULATION 510.3 states that every item of electrical equipment shall be selected and erected so as to allow compliance with the regulations stated in this chapter and the relevant regulations in other parts of BS7671 and shall take account of manufacturers instructions.




cable installation


method

B. A separately electrically protected regularly used lighting circuit.

circuit at the dwellings

main distribution board.





Elements of Electrical Protection will include short circuit, overcurrent and may also include additional protection by a residual current device (30mA) for certain installation methods covered by BS7671 (522.6.201) & (522.6.202)

IF ADDITIONAL PROTECTION IS REQUIRED BY BS7671 THE NEED FOR SEPARATE ELECTRICAL PROTECTION CANNOT BE MET BY DUAL RCD CONSUMER UNIT ARRANGEMENTS WHERE SINGLE RESIDUAL CURRENT DEVICES PROTECT GROUPS OF CIRCUITS.


**NB** - The IET onsite guide also recommends that where metal consumer units are installed into TT systems protection from faults arising from the possibility of mains tails becoming loose and making contact with the metal enclosure by incorporating into the installation a 100mA time delayed (S type) RCCB.

Furthermore in all cases the mains tails should be protected at the point of entry into the metal enclosure by use of a mains tails gland to protect against the possibility of mechanical damage and or disturbance that could lead to tails becoming loose and making contact with the metal enclosure.

British Standards and IEE regulations are subject to change and amendment. This guide to Crabtree consumer units is not a substitute for the regulations which should always be used for all types of electrical installation design, and installation work.

# **DIMENSIONS**

# **METAL ENCLOSURES**



# STARBREAKER SIZE 4 ENCLOSURE (504/0A)

DIMENSIONS A =185mm B =130mm C =104mm 502/26B 502/343B 502/363GU

502/2B 502/363B

# STARBREAKER SIZE 6 ENCLOSURE (506/0A)

DIMENSIONS A =261mm B =188mm C =121mm 504/2B 504/383B

504/343B

# STARBREAKER SIZE 9 ENCLOSURE (509/0A)

DIMENSIONS A =261mm B =242mm C =121mm

507/2B 504/2263B 505/232B 507/383B 507/343B

# STARBREAKER SIZE 12 ENCLOSURE (512/0A)

DIMENSIONS A =261mm B =292mm C =121mm 507/2563B 510/2B 507/2263B 507/2583B

510/313B

510/383B

513/238565B

513/228665B

507/2363B 508/232B 507/2383B 508/242B 508/252B 507/2463B 507/2483B 508/262B

507/2283B

#### STARBREAKER SIZE 15 ENCLOSURE (515/0A) STARBREAKER SIZE 20 ENCLOSURE (520/0A)

DIMENSIONS A =261mm B =343mm C =121mm 508/22623B 510/2683B 508/226363B 510/2763B 508/2834634B 511/242B 509/242124B 511/252B 510/2363B 511/262B 510/2383B 511/272B 510/2463B 511/282B 510/2483B 513/2B 510/2563B 513/313B 510/2583B 513/383B 509/218484B 510/2663B

DIMENSIONS A =261mm B =438mm C =121mm


513/226764B	513/256563B	515/2183B	516/212B
513/226863B	513/2637636B	515/2563B	516/262B
513/23624B	513/2638635B	515/2663B	516/272B
513/236565B	513/2639634B	515/2683B	516/282B
513/236664B	513/266463B	515/2763B	516/292B
513/236763B	513/2837636B	515/2783B	518/2B
513/23824B	513/2838635B	515/2863B	518/313B
513/246564B	513/2839634B	515/2883B	518/383B
513/246663B	514/272126B	515/2963B	512/2683B
513/25626B	514/282125B	515/2983B	513/226665B
513/256464B	515/2163B	516/2112B	513/238585B

# **CONSUMER UNIT PATTRESSES**

ENCLOSURE	PATTRASS	LEFT/RIGHT	TOP/BOTTOM
WIDTH	DEPTH	ENTRY	ENTRY
6 Module	16mm	MNSPE6670/1NR	MNSPE6584/1NR
9 Module	16mm	MNSPE6670/2NR	MNSPE6584/2NR
12 Module	16mm	MNSPE6670/3NR	MNSPE6584/3NR
15 Module	16mm	MNSPE6670/4NR	MNSPE6584/4NR
20 Module	16mm	MNSPE6670/5NR	MNSPE6584/5NR

For use with Crabtree All Metal consumer units. Allows surface cable entry through rear knockouts and automatically maintains enclosure IP rating to comply with BS7671 and BSEN61439-3 and the IET onsite guide.

#### TOP/BOTTOM CABLE ENTRY LEFT/RIGHT CABLE ENTRY

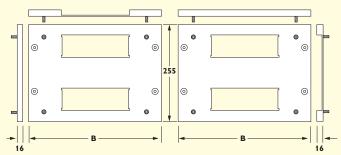

Cable entry slot line up with rear knockouts, the minimum number of knockouts only should be removed for cable

Suitable for use with trunking systems.

# 

# STARBREAKER SIZE 24 ENCLOSURE (524/2A)

DIMENSIONS A =506mm B =295mm C =121mm

517/26383B 520/283B

# STARBREAKER SIZE 30 ENCLOSURE (530/2A)

DIMENSIONS A =506mm B =345mm C =121mm


523/26383B 526/283B

# STARBREAKER SIZE 40 ENCLOSURE (540/2A)

DIMENSIONS A =506mm B =440mm C =121mm

533/26383B 536/283B

# SPINE BACKPLATE ASSEMBLIES (White PVC Cover)



# STARBREAKER 15 MODULE SPINE BACKPLATE UNIT (10W & 13W)

DIMENSIONS A =235mm B =335mm C =106mm D =180mm E =319.5mm

H910/2463WB H910/2563WB H913/2WB H910/2483WB

H910/2583WB

H910/2663WB

# STARBREAKER 20 MODULE SPINE BACKPLATE UNIT (18W)

DIMENSIONS A =235mm B =448mm C =106mm D =180mm E =435mm H918/2WB

# **STARBREAKER 15 MODULE DRCD (8W)**

DIMENSIONS A =205mm B =333mm C =106mm D =140mm E =320mm 908/2834634B

# STARBREAKER INCOMING DEVICES AND ENCLOSURES **ENCLOSURES**

MODULAR WIDTH	ALL METAL
4	504/0A
6	506/0A
9	509/0A
12	512/0A
15	515/0A
20	520/0A
24	524/0A
30	530/0A
40	540/0A

# **DOUBLE POLE MAIN SWITCH DISCONNECTORS**

RATING	MODULAR WIDTH	LIST No	
40A	2	40/M12*	
63A	2	63/M12*	
100A	2	100/MI2*	
100A	2	100/2MT**	

<sup>\*</sup> Used within main switch only and split-load applications

# **FLUSH MOUNTING KIT**

MODULAR WIDTH	ALL METAL	
6	506/FLA	
9	509/FLA	
12	512/FLA	
15	515/FLA	
20	520/FLA	
24	524/FLA	
30	530/FLA	
40	540/FLA	

# **RESIDUAL CURRENT CIRCUIT BREAKERS**

RATING	MODULAR WIDTH	LIST No
40A 30mA	2	340/030
63A 30mA	2	363/030
80A 30mA	2	380/030
100A 30mA	2	310/030
63A 30mA	3	363/5030*
80A 30mA	3	380/S030*

<sup>\*</sup> Dedicated as a split-load RCCB (3 modules)

# **REPLACEMENT COVERS FOR 5 SERIES ENCLOSURES**

MODULAR WIDTH	ALL METAL
6	506/LID
9	509/LID
12	512/LID
15	515/LID
20	520/LID

# AM 3 UPGRADE / REPLACEMENT COVERS FOR 8 SERIES **ENCLOSURES**

MODULAR WIDTH	LIST No
6	806/LID255G
9	809/LID255G
12	812/LID255G
15	815/LID255G
20	820/LID255G

フ  $\Box$ 

刀  $\Box$  $\triangleright$ 

 $\Box$ 

<sup>\*\*</sup> Used within high integrity and dual RCD applications