


Lighting Marshalling Boxes (LMB) - Fixed Wiring
16A Rated LMB Complying to BS 5733:2010



KLMB4W

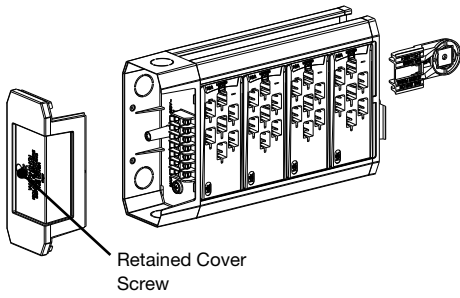

KLMB6W



KLMB8W




KLMB10W



KLMB12W




Lighting Marshalling Boxes (LMB) - Pluggable
16A Rated LMB Complying to BS 5733:2010

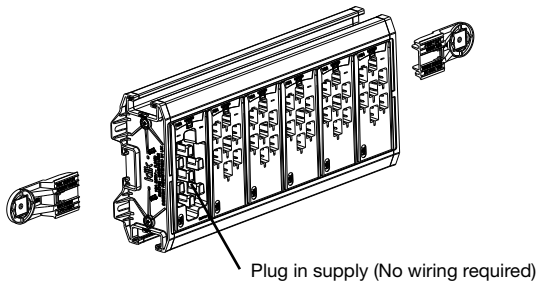

KLMB5P




KLMB7P




KLMB9P



KLMB11P



Dual Channel Lighting Marshalling Boxes (LMB) - Fixed Wiring
16A Rated LMB complying to BS 5733:2010

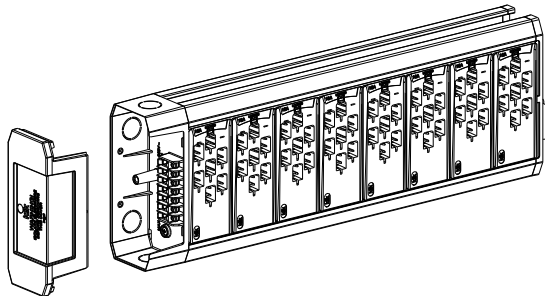

KLMB244W




KLMB255W



KLMB266W



Grouped Circuits - Control

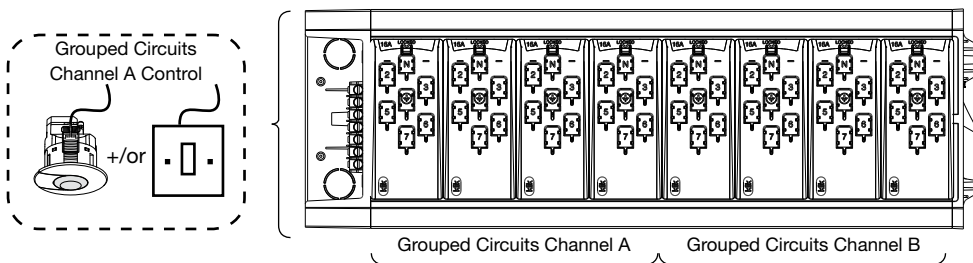

1. Grouped Circuits Channel A can be controlled by using pluggable sensors and/or pluggable switch. Alternatively hard wired sensors and/or switches can be used.

2. Grouped Circuits Channel B must use pluggable sensors and/or switches for control.

