



RESIDUAL CURRENT CIRCUIT BREAKER WITH OVERCURRENT PROTECTION (RCBOs)

RATING	MODULES	LIST No	
		30mA Type B	30mA Type C
6A	1	61/B10630	61/C10630
10A	1	61/B11030	61/C11030
16A	1	61/B11630	61/C11630
20A	1	61/B12030	61/C12030
32A	1	61/B13230	61/C13230
40A	1	61/B14030	61/C14030
50A	1	61/B15030	61/C15030

- EN 61009-1, IEC61009-1.
- 230 (240)V AC 50/60 Hz.
- 16mm² terminal capacity.

CAUTION

These devices are electronic units and should be disconnected from the supply during insulation and earth fault loop impedance testing.



ACCESSORIES


Metal Blanking Plate	543
MCB Padlocking Device	MCBLD
Universal Adaptor*	MTCG32

* As recommended in the IET On Site Guide



MEMBRANE CABLE ENTRIES KIT (FLAME RETARDENT)

7 x 20mm & 3 x 32mm	CRCE1
10 x 20mm	CRCE2

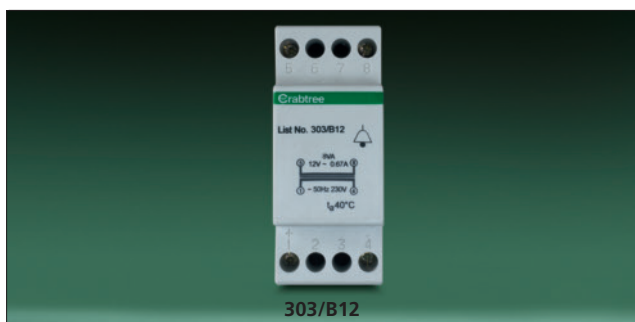

BELL TRANSFORMER

DESCRIPTION	MODULES	LIST No
12V bell transformer	2	303/B12

- With overload protection.



DIGITAL TIMESWITCHES

DESCRIPTION	MOD	LIST No
1 Channel Digital Timeswitch	1	301/TD1
1 Channel Digital Timeswitch	2	302/TD1
2 Channel Digital Timeswitch	2	302/TD2
1 Channel Digital Timeswitch + data key facility	2	402/TD1
2 Channel Digital Timeswitch + data key facility	2	402/TD2
1 Channel Digital Astro Timeswitch + data key facility	2	502/TD1
2 Channel Digital Astro Timeswitch + data key facility	2	502/TD2
1-10 min Staircase Timeswitch	1	301/S10
Software		USB/S
Data Key		4/5DK
Data Key		6DK



ANALOGUE TIMERS

DESCRIPTION	MODULES	LIST No
24hr Analogue Quartz	1	301/TQ24
24hr Analogue Quartz	3	303/TQ24
7 Day Analogue Quartz	3	303/TQ7
24hr Analogue Synchronous	1	301/TS11
24hr Analogue Synchronous	3	303/TS24