

Data Sheet | Item Number: 2007-8444

Adjacent jumper for switching lever; 4-way; insulated; orange

https://www.wago.com/2007-8444

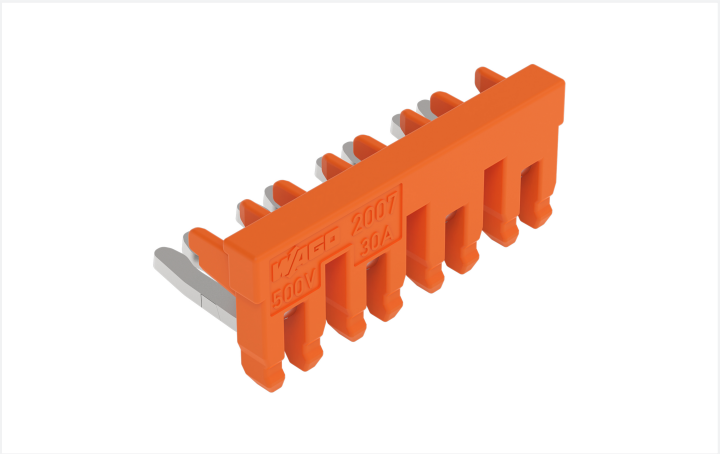

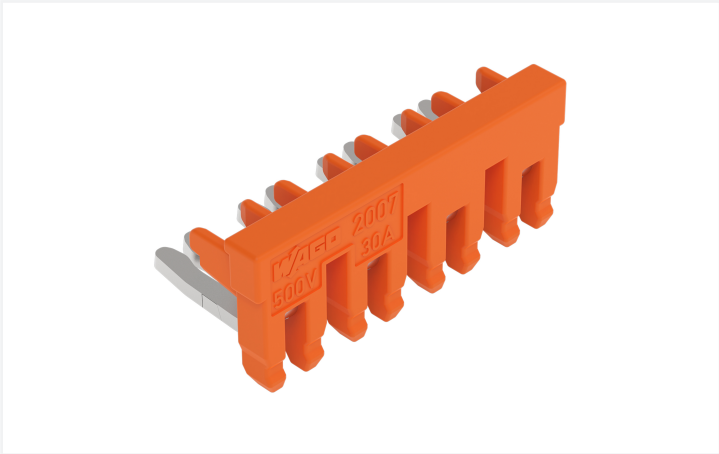

Color: orange



Electrical data	
Rated current	30 A

Physical data	
Width	31.2 mm / 1.228 inches
Depth	13 mm / 0.512 inches

Material data	
Color	orange
Fire load	0.023 MJ
Weight	3.9 g

Continued on next page

Commercial data

Product Group	22 (TOPJOB S)
PU (SPU)	50 (10) pcs
Packaging type	Box
Country of origin	DE
GTIN	4050821458425
Customs tariff number	85366990990

Product Classification

UNSPSC	39121421
eCl@ss 10.0	27-14-11-40
eCl@ss 9.0	27-14-11-40
ETIM 9.0	EC000489
ETIM 10.0	EC000489
ECCN	NO US CLASSIFICATION

Environmental Product Compliance

RoHS Compliance Status	Compliant,No Exemption

Environmental requirements

Environmental Testing

Test specification: Railway applications – Rolling stock – Electronic equipment	DIN EN 50155 (VDE 0115-200):2022-06
Test procedure: Railway applications – Rolling stock equipment – Vibration and shock tests	DIN EN 61373 (VDE 0115-0106):2011-04
Spectrum/Mounting location	Service life test, Category 1, Class A/B
Functional test with noise-like oscillations	Test passed according to Section 8 of the standard
Frequency	$f_1 = 5$ Hz to $f_2 = 150$ Hz
Acceleration	0.101g (highest test level used for all axes)
Test duration per axis	10 min.
Test directions	X, Y and Z axes
Monitoring of contact faults and interruptions	Passed
Voltage drop measurement before and after each axis	Passed
Simulated service life test through increased levels of noise-like oscillations	Test passed according to Section 9 of the standard
Frequency	$f_1 = 5$ Hz to $f_2 = 150$ Hz
Acceleration	0.572g (highest test level used for all axes)
Test duration per axis	5 h
Test directions	X, Y and Z axes
Extended testing: Monitoring of contact faults and interruptions	Passed
Extended testing: Voltage drop measurement before and after each axis	Passed
Shock test	Test passed according to Section 10 of the standard
Shock pulse form	Half sine
Acceleration	5g (highest test level used for all axes)
Shock duration	30 ms
Number of shocks (per axis)	3 pos. und 3 neg.
Test directions	X, Y and Z axes

Environmental Testing

Extended testing: Monitoring of contact faults and interruptions	Passed
Extended testing: Voltage drop measurement before and after each axis	Passed
Vibration and shock stress for rolling stock equipment	Passed

Continued on next page

Approvals / Certificates

Declarations of conformity and manufacturer's declarations

Approval	Standard	Certificate Name
Railway WAGO GmbH & Co. KG	-	Railway Ready

Downloads

Environmental Product Compliance

Compliance Search

Environmental Product Compliance 2007-8444

Documentation

Bid Text

2007-8444	28.04.2017	doc 23.00 KB
2007-8444	19.02.2019	xml 2.52 KB

CAD/CAE-Data

CAD data

2D/3D Models 2007-8444

CAE data

EPLAN Data Portal 2007-8444

WSCAD Universe 2007-8444

ZUKEN Portal 2007-8444

Installation Notes

Commoning



Preparing shorting path for the current transformer circuits.



Insert insulated, touch-proof circuit jumpers into jumper slot.



Insert insulated, touch-proof circuit jumpers into jumper slot.